

# Hanko Koverhar Megasize Data Center Site



# WHY INVEST YOUR DATA CENTER IN FINLAND?

# Finland offers major benefits for Data Center investors and operators


Reliable and green energy



World class connectivity



## **BUILD YOUR NEXT DC IN FINLAND**

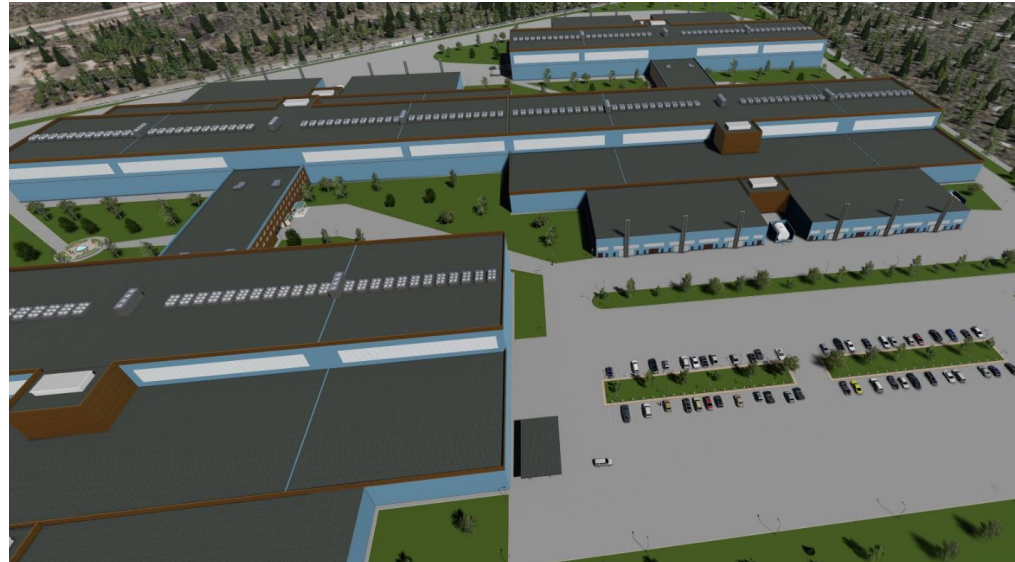

Cost efficient to invest and operate



Safe society and cyber security




# Reliable energy production and distribution

## Finland has One of the Most Reliable Electric Grids in the World!


Transmission reliability: **99,99982%**

Average duration of forced interruptions: **2.1 min**

### Fingrid Transmission Reliability History

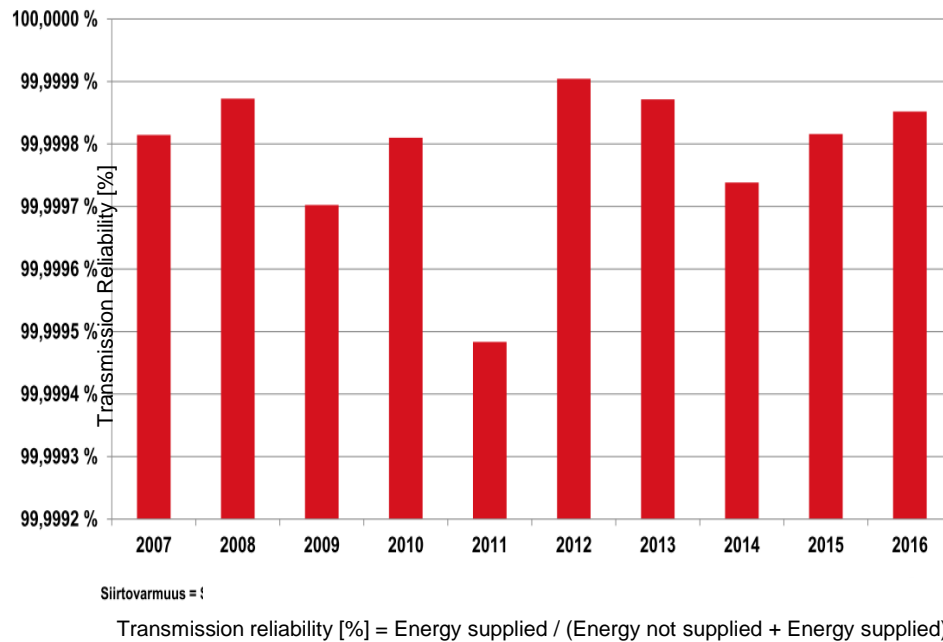


### Number and Reasons of Disturbances

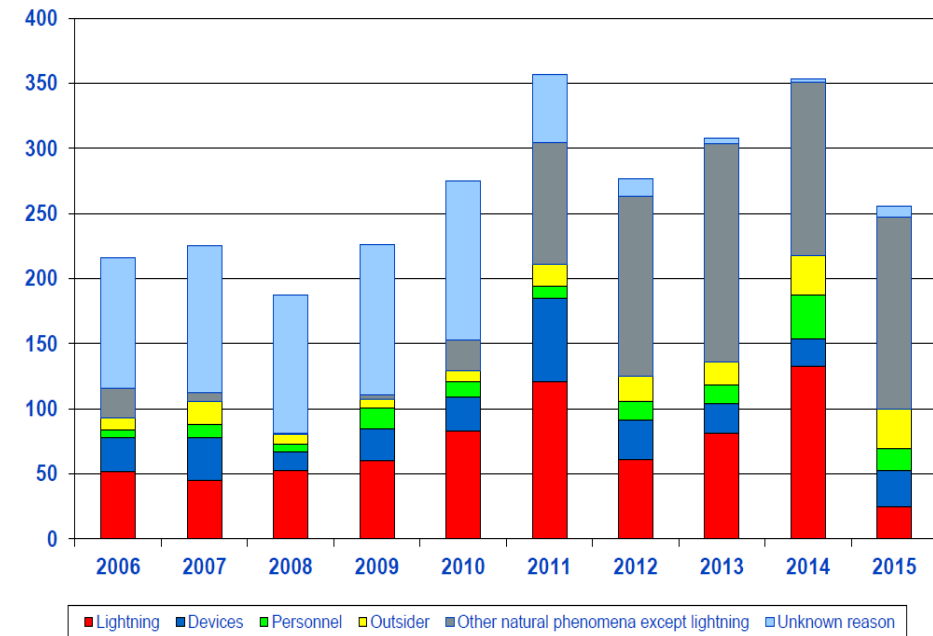

# Renewable electricity production

## Electricity Production by Energy Sources 2016 (66,1 TWh)

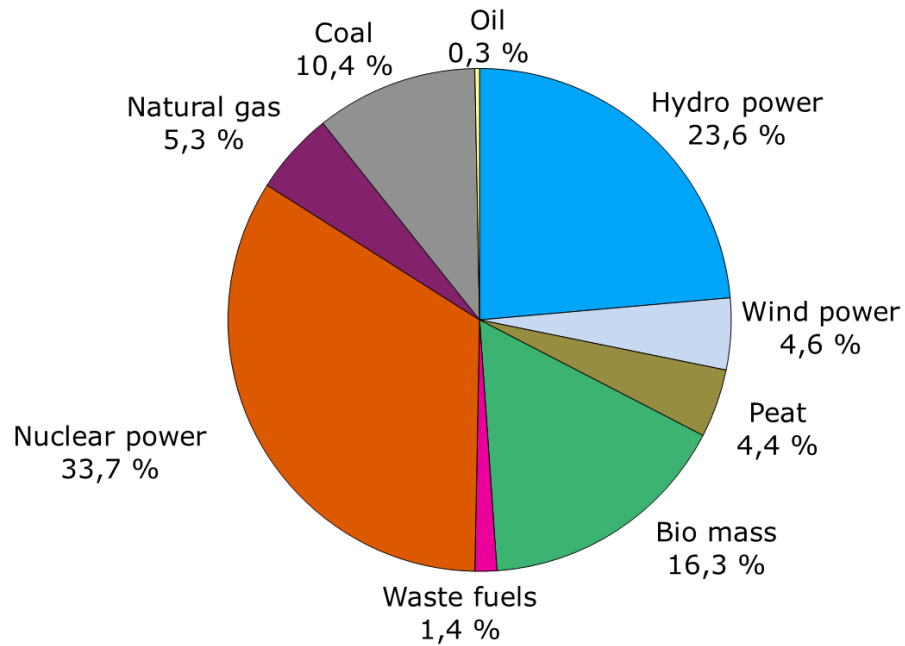


Renewable 45 %

(Year 2015: 45 %)

Carbon dioxide free 78 %

(Year 2015: 79 %)

## CO<sub>2</sub>-emissions of Power Production

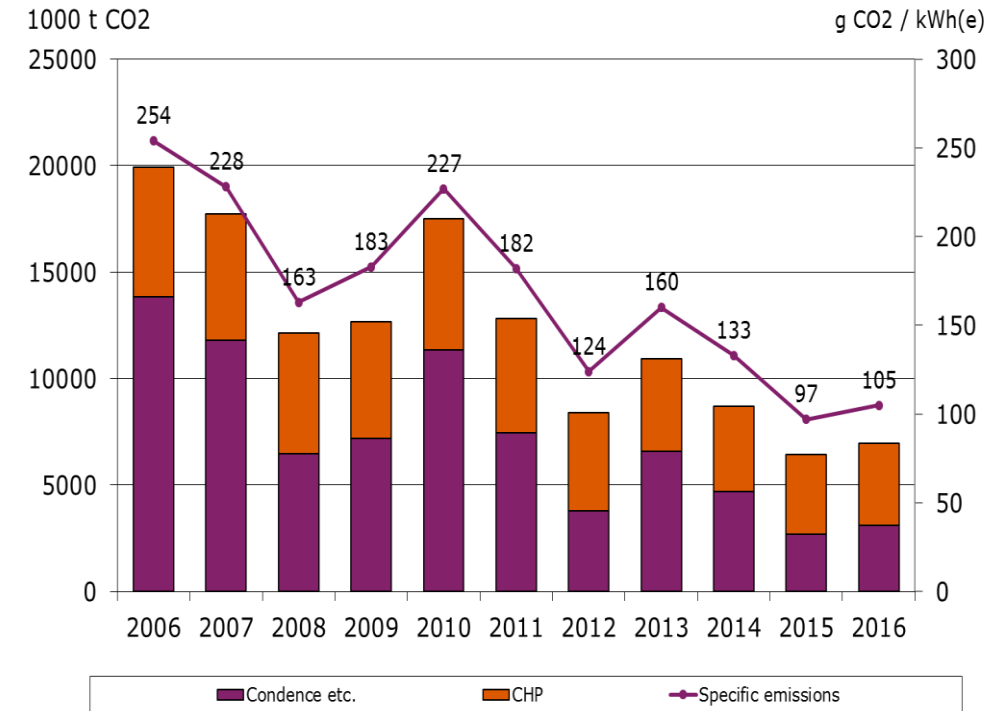


CO<sub>2</sub>-emissions are reduced to 1/3 from 2006 to 2016

# Low energy price invites to Finland

## Energy cost in Finland is about 50% LESS than in Germany?

**ELECTRICITY PRICES FOR INDUSTRIAL CONSUMERS**  
Save up to 50 % on energy cost as compared to Central Europe

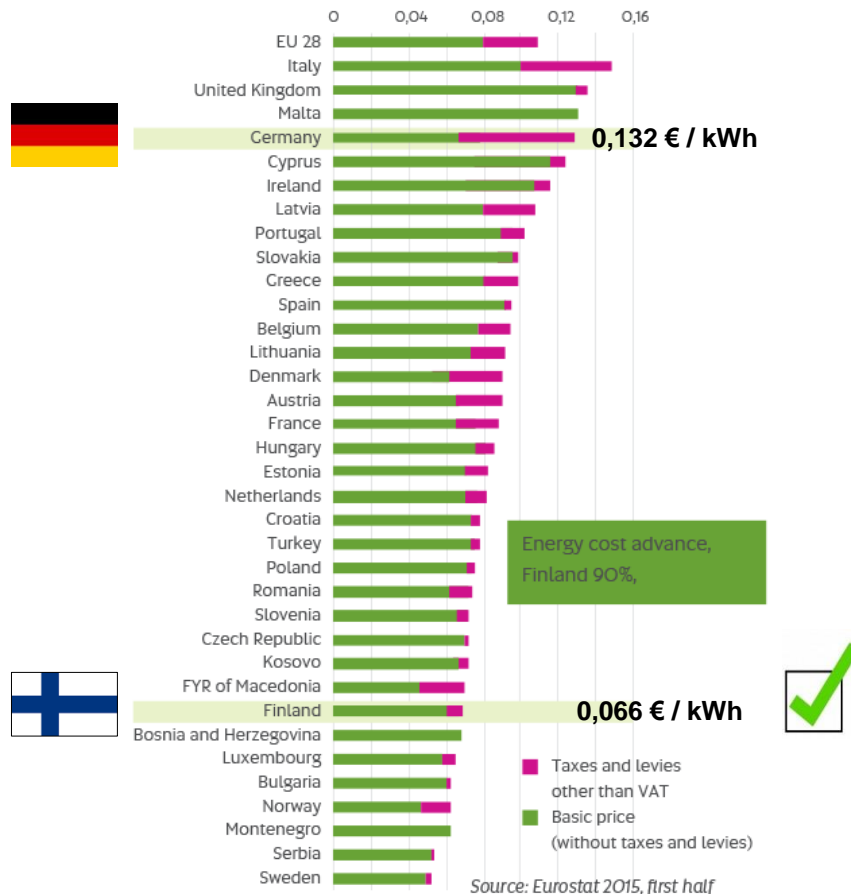

## Breakdown of Energy Cost

Cost item	€/ MWh
Nord Pool Spot (3.10.2016)	26,95
National grid fee	7,40
Local margin	1 – 3
Electricity tax	7,16
<b>Total</b>	<b><u>43 – 46 € / MWh</u></b>

- The Nord Pool is the common Nordic and Baltic wholesale market
- The price of electricity is determined hourly, based on the balance of demand and supply
- Price differences and electricity price level are expected to be very stable and low due to decentralized energy production in Finland. The power production capacity will increase significantly within the next 2-3 years when Olkiluoto 3 (a new 1600MW power plant) will start operations.

## **Top education but competitive employment costs**

- Finnish people enjoy top level education for it's students. PISA (Programme for International Student Assessment) has qualified Finland many times as the best in the world regarding the level of education
- Although top education, the employment costs for Finnish engineers are lower than in other European countries in average.

## **Lower company tax structure**

- Company taxation in Finland is 20 % which is much lower than average in OECD or EU countries.

## **Free cooling saves energy and costs**

- Cool climate and pure air including numerous clean lakes and rivers plus 1100 km coast line gives many cost effective locations for cooling Data Center servers.
- Due to cool climate the need to invest to mechanical cooling systems is lower and warm periods are short in Finland => lower TCO

## **Lower taxation for project key personnel**

- It's possible to get lower taxation for the project key management personnel for two years.

# Unique possibility to sell Data Center's waste heat

## Waste Heat = Product for Sale

- Finland has a district heating system in almost every town. This creates an excellent possibility to re-use waste heat from data centers
- Yandex – Russian search engine, has built a data center in Mäntsälä, Southern Finland. Yandex sells its waste heat to the local utility Nivos. Nivos primes waste heat with help of heat pumps suitable for the district heating network for Mäntsälä's consumers.
- This is an excellent showcase of the "win-win" trade for the waste heat use.
- In addition, with the use of data center's waste heat as an energy source, Nivos can lower their carbon footprint significantly.



**Nivos could reduce their CO<sub>2</sub>-emissions by 40% by re-using waste heat from Yandex Data Center.**



# Finland is a gateway between East and West


- State of the art domestic fiber network is well connected to global networks
- Hub of global data flows linking Europe, Russia and Asia
- C-Lion1, The new high capacity, super fast submarine cable route from Finland to Central Europe, is now operational.
- C-Lion1 has a record breaking capacity of 18 Tbit/s per fiber pair, total capacity of 144 Tbit/s.
- Measured RTD between Helsinki-Frankfurt is 19,7 ms



City	Frankfurt	Hamburg	Amsterdam	London	Moscow	Tokyo	Hong Kong
Helsinki	<b>19,7</b>	<b>14,2</b>	19,0	23,9	11,7	130,8	132,8
Frankfurt		5,8	11,1	11,6	31,4	150,0	152,0
Hamburg			5,3	10,3	25,9	145,0	147,0
Amsterdam				5,2	30,7	149,7	151,7
London					35,7	154,7	156,7

# Future connectivity plans


- The new submarine fiber optic routes from Europe to Asia (ARCTIC CONNECT and ARCTIC FIBRE) will lower latency between Europe and Asia about 90 - 100ms compared to traditional route (*Atlantic-Mediterranean-Suez-Red Sea-Indian Ocean-South China Sea*)
- These projects are waiting for the implementation decision.

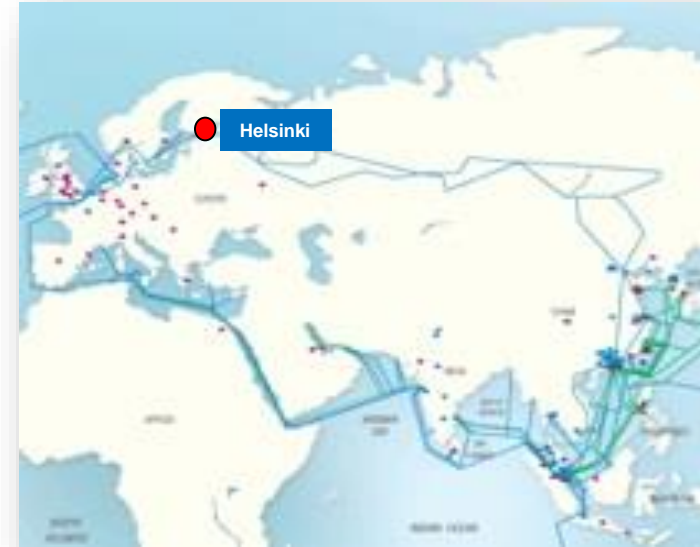

Source: Datacenter Dynamics




Source: LaserFocusWorld

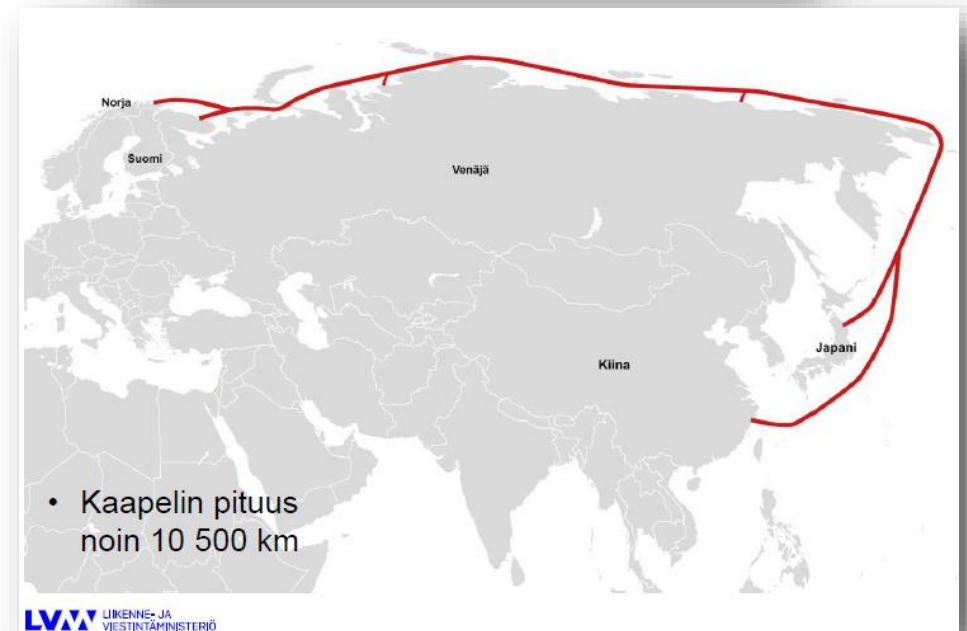

# Safe geological location and nature

- Finland is geologically very safe because it lies on a very old and stable bedrock
- Finnish climate is generally mild with no hurricane class storms
- Baltic Sea floods very seldom and its all time record of sea level rise have been only 1.9 m in 2005. Areas that face risk of flooding are predictable.
- Building Regulations demands to build a min. of 3 m above the sea level

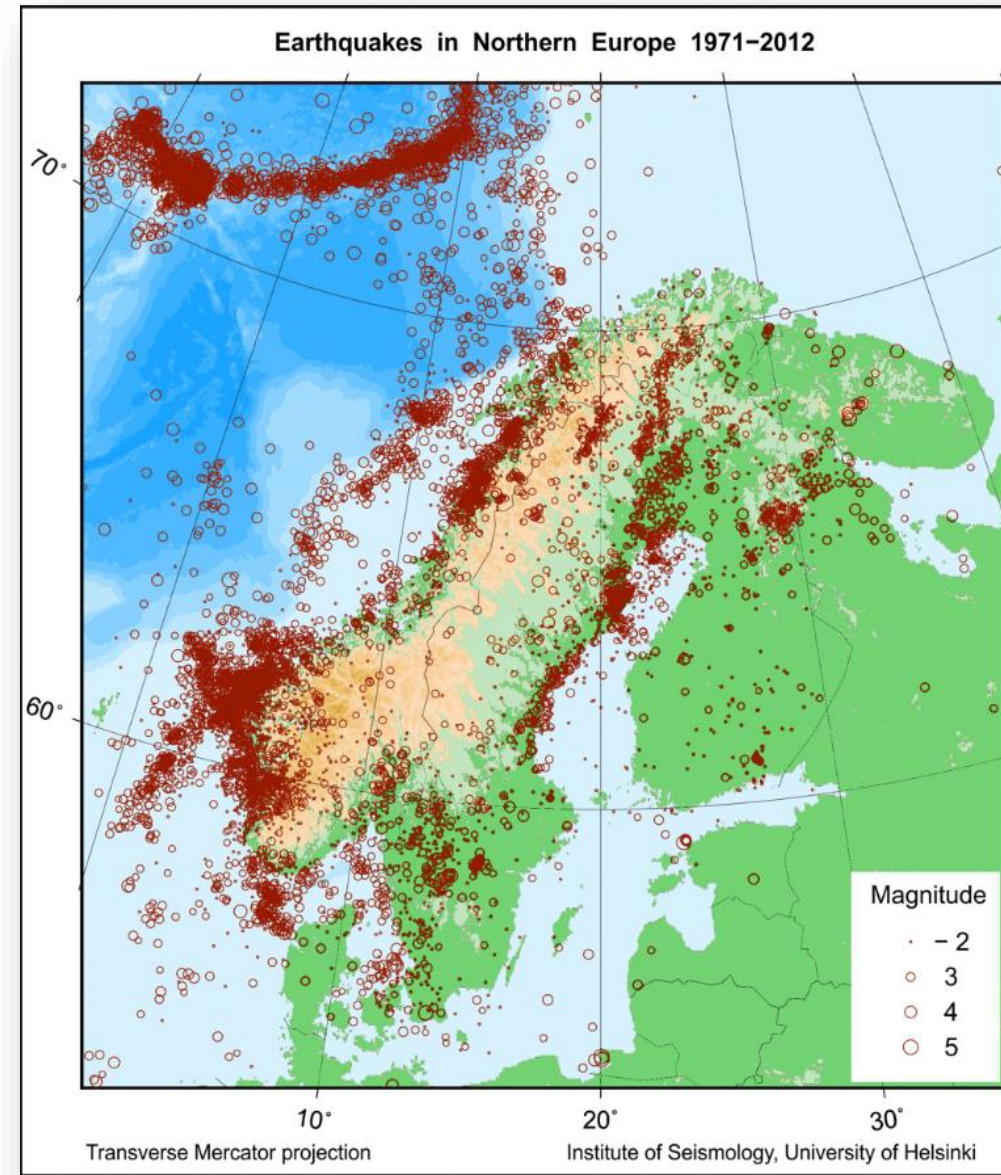

# Stable society honours privacy

- In addition to Finland being an ideal location for data centers, it is also a safe place to save and keep information
- The Finnish information privacy legislation is quite different from other European countries
  - Unlike most other European countries and including other Nordic countries, Finland adheres strongly to its policies on the right of privacy of individuals and corporations and enforces it's own regulation without exception.
- In Finland privacy of information is a basic right that is inviolable and sacred
  - The same laws on data sovereignty applies to all forms of (stored) information and communication (digital or not)
  - In Finland there is a strong legal protection over any surveillance of information and a dedicated authority that has the power to ensure compliance
  - Officials may not survey information unless their work requires it.
- The favourable legislation to store and handle information has led many data center operators to establish business in Finland.

# Finland qualified no.1 in Fragile State Index

“The Fragile States Index is an annual ranking of 178 nations based on their levels of stability and the pressures they face. The Index is based on The Fund for Peace’s proprietary Conflict Assessment Software Tool (CAST) analytical platform. Based on comprehensive social science methodology, data from three primary sources is triangulated and subjected to critical review to obtain final scores for the Fragile States Index”.

Global Innovation index states that with innovation Finland is in 5th place 2016. [Global Innovation](#)

Very Sustainable	Very Stable	Low Warning	Warning
17.8 Finland (178)	40.9 Malta (=151)	61.9 Albania (125)	70.5 Guyana (107)
<b>Sustainable</b>	40.9 Spain (=151)	62.1 Seychelles (134)	70.8 Namibia (106)
20.2 Sweden (177)	41.5 Chile (150)	62.6 Brazil (123)	71.2 Dominican Republic (105)
20.8 Norway (176)	42.6 Slovak Republic (144)	62.8 Botswana (122)	71.3 Gabon (=103)
21.5 Denmark (175)	43.0 Lithuania (148)	63.0 Brunei Darussalam (121)	71.3 Paraguay (=103)
22.2 Luxembourg (174)	43.2 Italy (147)	63.4 Grenada (120)	71.4 El Salvador (102)
22.3 Switzerland (173)	43.8 Estonia (146)	64.3 Bahrain (119)	71.6 Saudi Arabia (101)
22.6 New Zealand (172)	45.2 Mauritius (145)	64.5 Macedonia (118)	71.8 Mexico (100)
23.4 Iceland (171)	46.2 United Arab Emirates (144)	64.6 Jamaica (117)	71.9 Ghana (=98)
24.3 Australia (170)	46.3 Qatar (143)	65.3 Belize (116)	71.9 Peru (=98)
24.7 Ireland (169)	46.7 Costa Rica (142)	65.9 Malaysia (115)	72.4 Vietnam (97)
25.7 Canada (168)	47.6 Argentina (141)	66.2 Cyprus (114)	73.0 Moldova (96)
26.0 Austria (167)	48.6 Latvia (140)	67.0 South Africa (113)	73.5 Cape Verde (95)
26.8 Netherlands (166)	49.1 Hungary (139)	67.4 Cuba (112)	73.6 Micronesia (94)
28.1 Germany (165)	49.3 Barbados (138)	68.2 Samoa (111)	73.7 Sao Tome & Principe (93)
29.7 Portugal (164)	<b>Stable</b>	68.3 Kazakhstan (110)	73.8 Serbia (92)
<b>Highly Stable</b>	51.0 Croatia (137)	68.4 Suriname (109)	74.2 Maldives (91)
30.4 Belgium (163)	51.6 Bahamas (136)	69.7 Armenia (108)	74.5 Turkey (90)
31.6 Slovenia (162)	52.0 Oman (135)		74.6 Morocco (89)
33.4 United Kingdom (161)	52.6 Greece (134)		
33.7 France (160)	54.2 Romania (=132)		
34.4 Singapore (159)	54.2 Montenegro (=132)		
35.3 United States (158)	54.6 Panama (131)		
36.0 Japan (157)	55.4 Bulgaria (130)		
36.3 South Korea (156)	57.0 Mongolia (129)		
36.5 Uruguay (155)	57.5 Kuwait (128)		
37.4 Czech Republic (154)	57.8 Antigua & Barbuda (127)		
39.8 Poland (153)	58.7 Trinidad & Tobago (126)		


Finland is no. 1 also in 2016.

# Data Center Risk Index 2016 qualified Finland no. 4

## THE INDEX RANKING BY COUNTRY

2016 RANK	REGION	INDEX SCORE (100= BEST)	COUNTRY	ENERGY - ELECTRICITY (COST PER KWH)	INTERNATIONAL BANDWIDTH (MEGABYTE PER S)	EASE OF DOING BUSINESS	CORPORATION TAX
1	EMEA	100.00	ICELAND	6	10	14	9
2	EMEA	96.21	NORWAY	11	7	7	23
3	EMEA	90.26	SWITZERLAND	8	5	16	6
4	EMEA	90.19	FINLAND	13	8	8	9
5	EMEA	89.92	SWEDEN	22	4	6	14
6	AMERICAS	85.07	CANADA	4	16	10	22
7	APAC	84.50	SINGAPORE	23	11	1	4
8	APAC	83.23	KOREA, REP.	2	1	2	16
9	EMEA	79.81	UNITED KINGDOM	30	14	4	13
10	AMERICAS	78.73	UNITED STATES	3	15	5	36
11	APAC	78.73	HONG KONG	21	2	3	3
12	EMEA	78.06	NETHERLANDS	29	6	18	17
13	APAC	76.48	JAPAN	20	3	21	35
14	EMEA	74.98	LUXEMBOURG	27	22	30	25
15	EMEA	74.73	QATAR	1	29	31	7
16	EMEA	73.75	GERMANY	34	18	11	26
17	EMEA	73.61	FRANCE	24	24	17	31
18	EMEA	73.31	CZECH REPUBLIC	28	9	22	7
19	EMEA	71.53	BULGARIA	14	13	23	1
20	EMEA	71.53	IRELAND	32	17	12	2

Risk Index listed 20 best qualified countries with least risk.

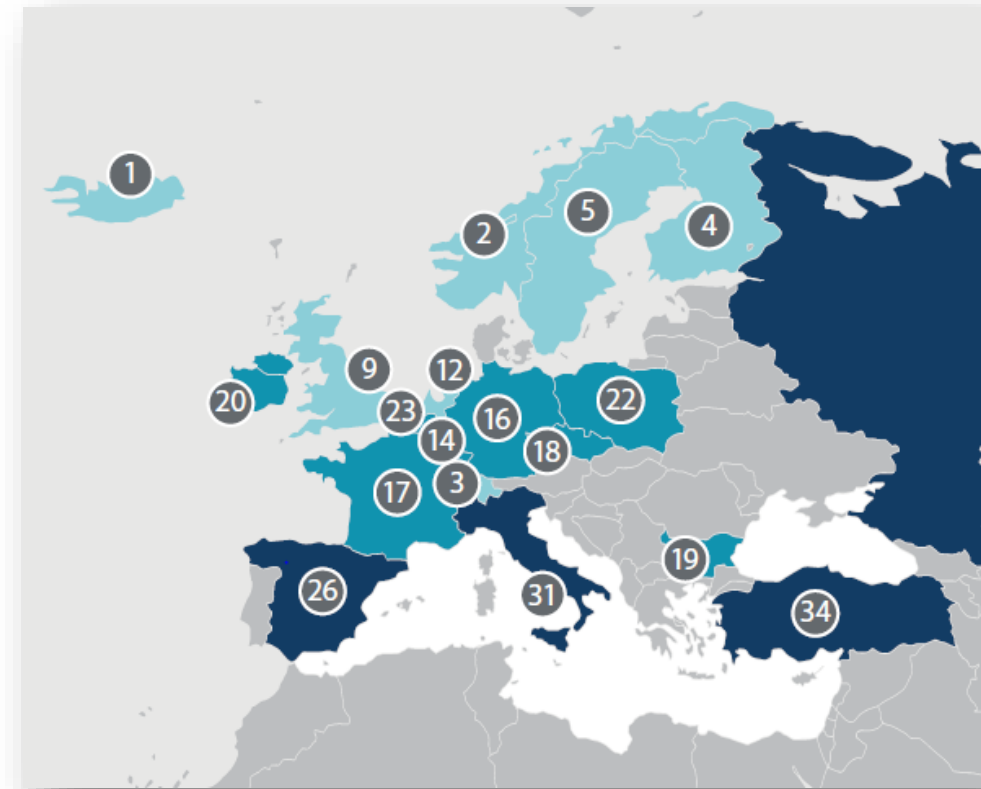


European countries' qualification in the Risk Index.

Cushman & Wakefield Data Center Risk Index 2016 Report highlights the most appropriate risks affecting data centre operations in today's current climate. It has been designed primarily to support data centre due diligence and senior decision making when considering global investment and deployment activities.

# LOCATION AND LOGISTICS

# Ideal Data Center site location

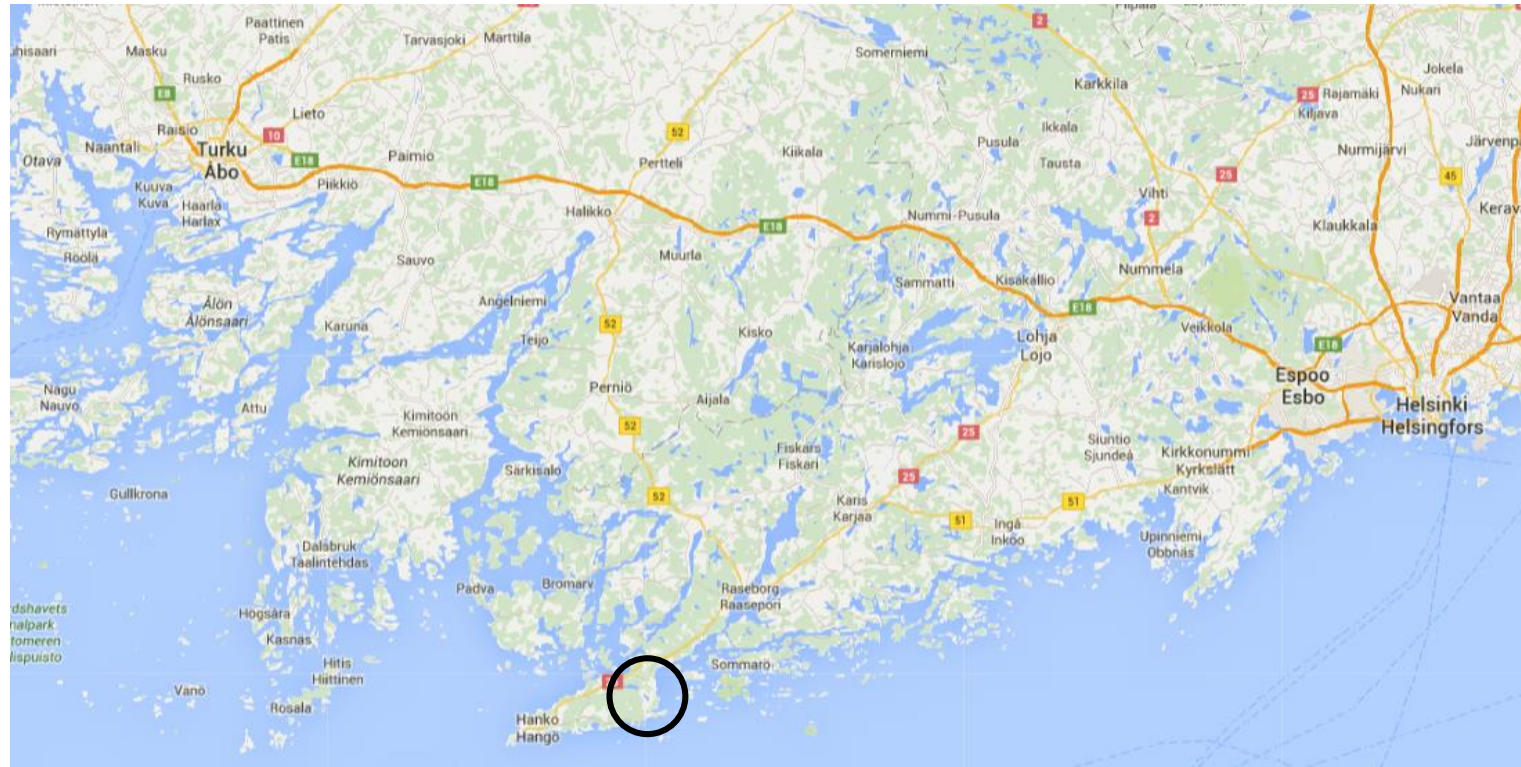


Hanko Koverhar Data Center site is located in the City of Hanko, Southern Finland

The site is ideal for data center operations in terms of location, power, cooling, fast track implementation and local support





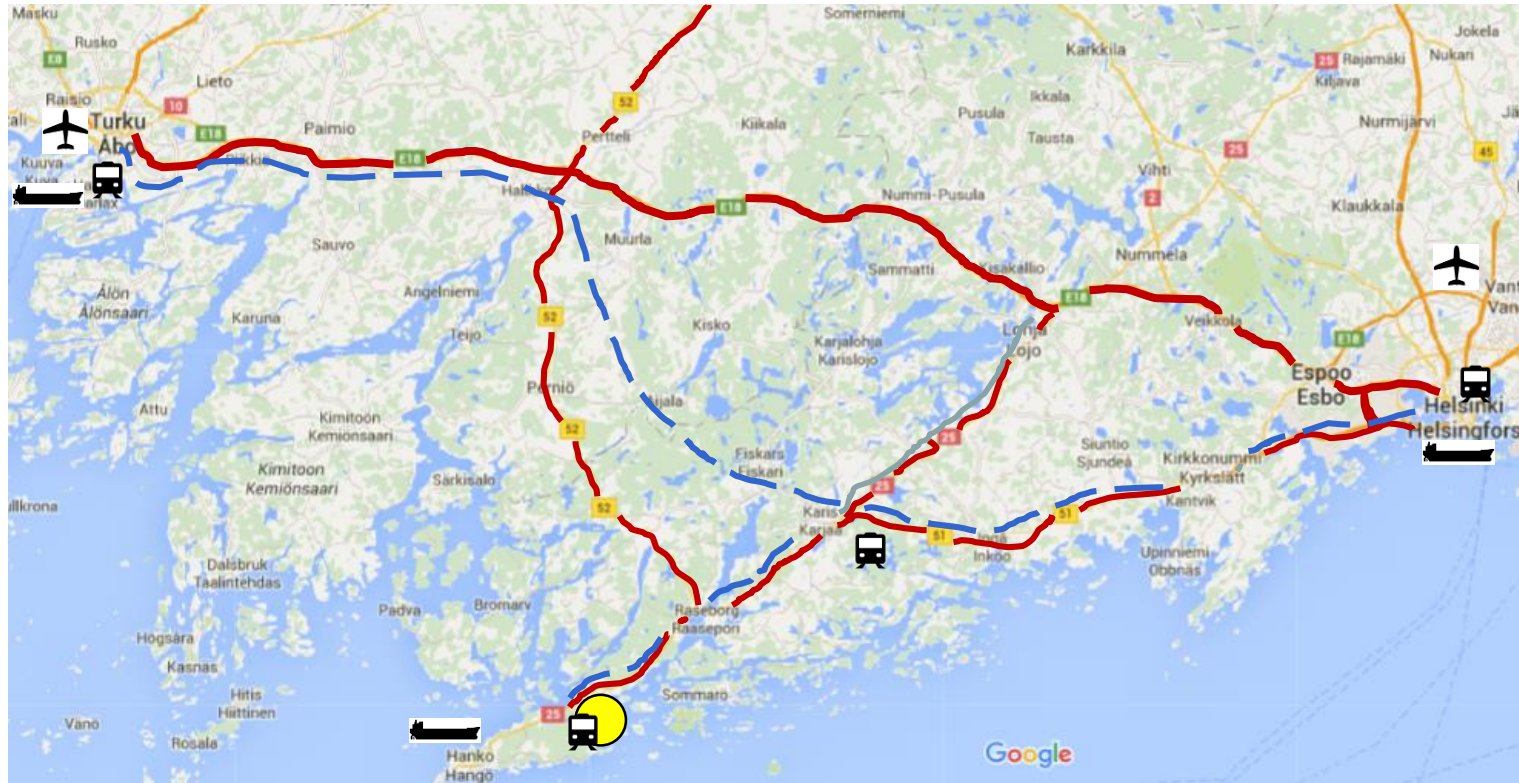




# Only 1h 30 min from Helsinki-Vantaa airport to Hanko




## Distances from DC site:

Railroad: 2 km  
To highway: 0,5 km  
Port of Helsinki: 130 km  
Hki-Vantaa Intl. airport: 125 km  
Turku : 140 km


-  Port/Harbour
-  4- lane motorway
-  Main roads
-  Railroad
-  Intl. airport
-  Railway station
-  Hanko Koverhar Data Center site

# Hanko Koverhar DC site

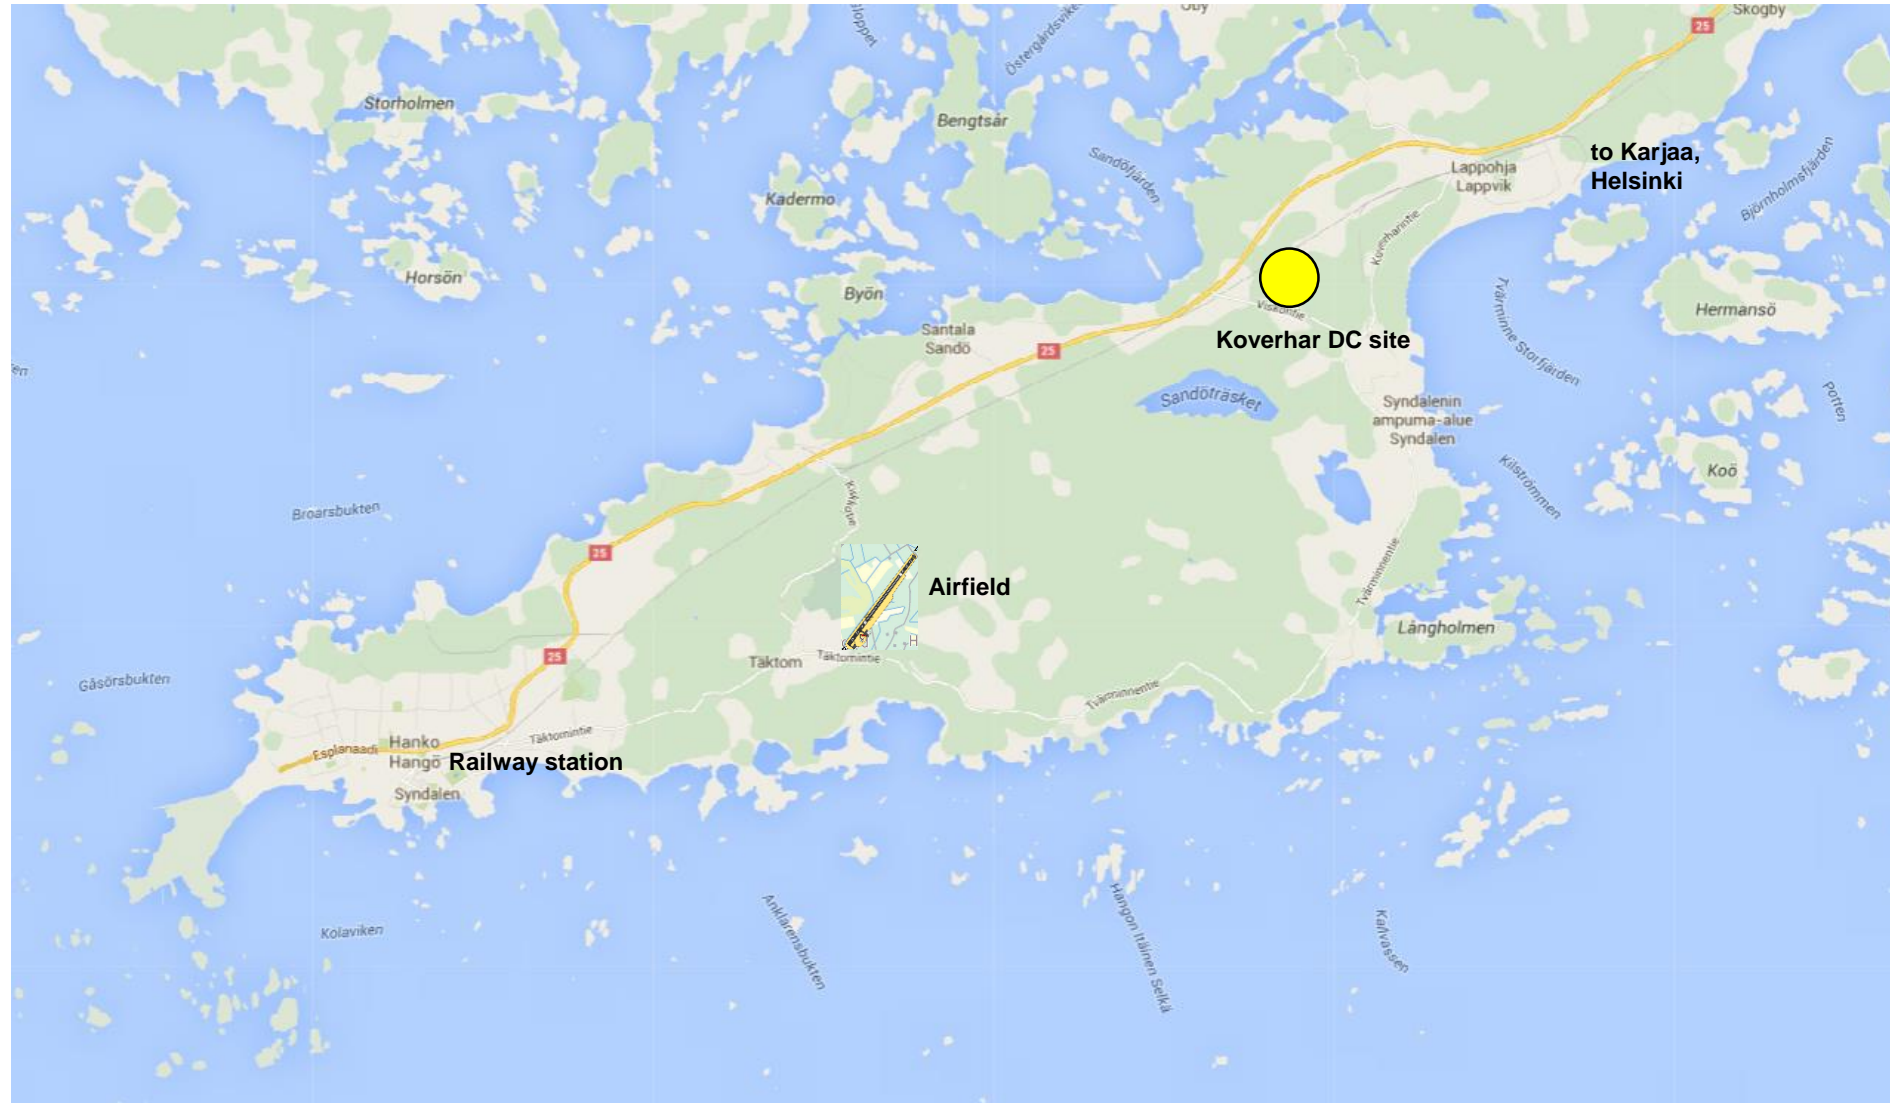

# Large area for Data Center use

- Almost flat landscape
- Zoned for industrial use like data centers
- Easy to build
- Feeding substation right next to the site
- Possible to enlarge data center area up to 100 ha if necessary

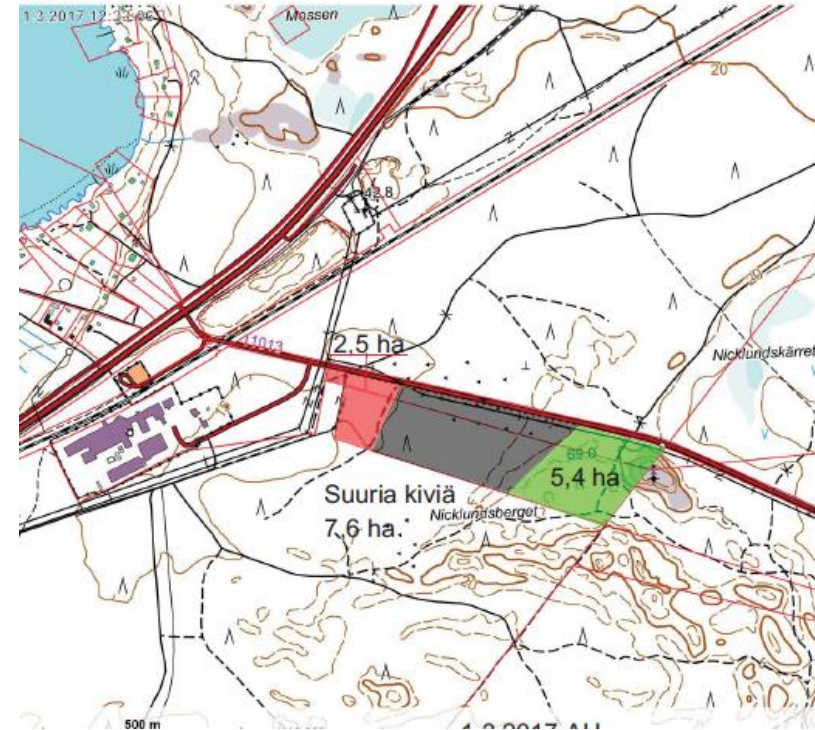

Sustainable and Green solar energy to DC use from nearby.


Coloured area next to the data center site is reserved for planned future solar power use.

# Location in relation to the sea, and minimum recommended building elevation

Statistics since establishing of  
Hanko mareograph in 1887:

- Min. building elevation +2.50
- Maximum +1.32
- Average of annual max. +0.74
- Average of annual min. -0.49
- Minimum -0.79

→ No flooding possibility

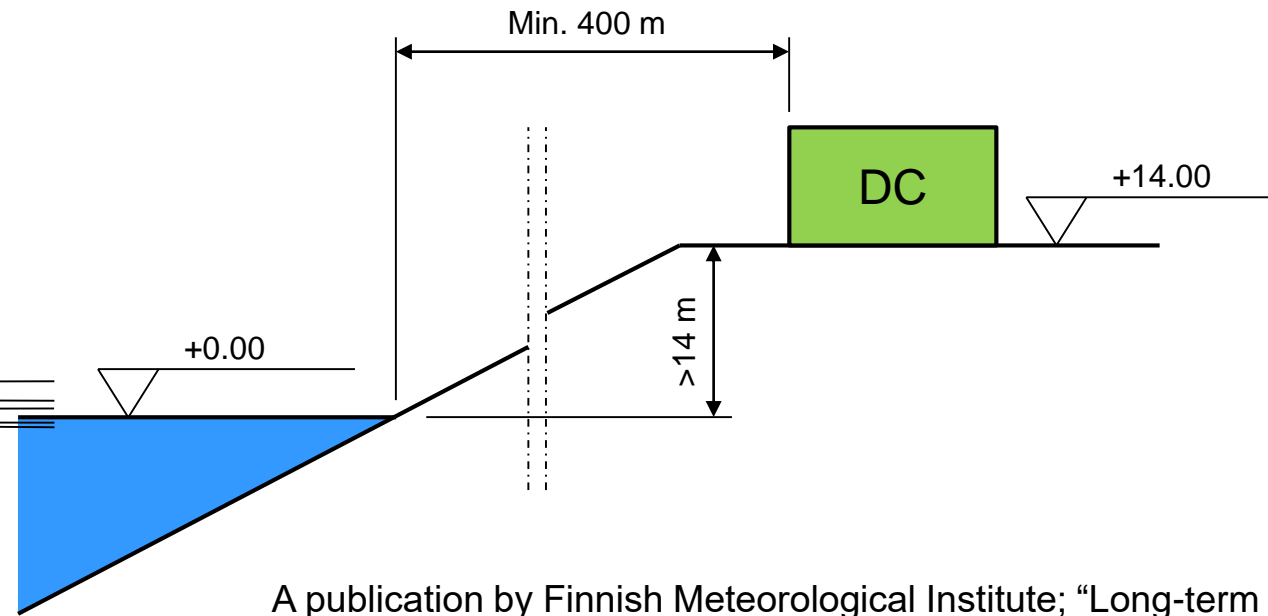


A publication by Finnish Meteorological Institute; “Long-term flooding risks and recommendations for minimum building elevations on the Finnish coast”, June 2014

The minimum recommended building elevations are based on the sea level in 2100 with an exceedance frequency of one event per 250 years.

Minimum recommended building elevation without wave compensation in Hanko is +2.50 m above sea level.

# Current landscape elevations

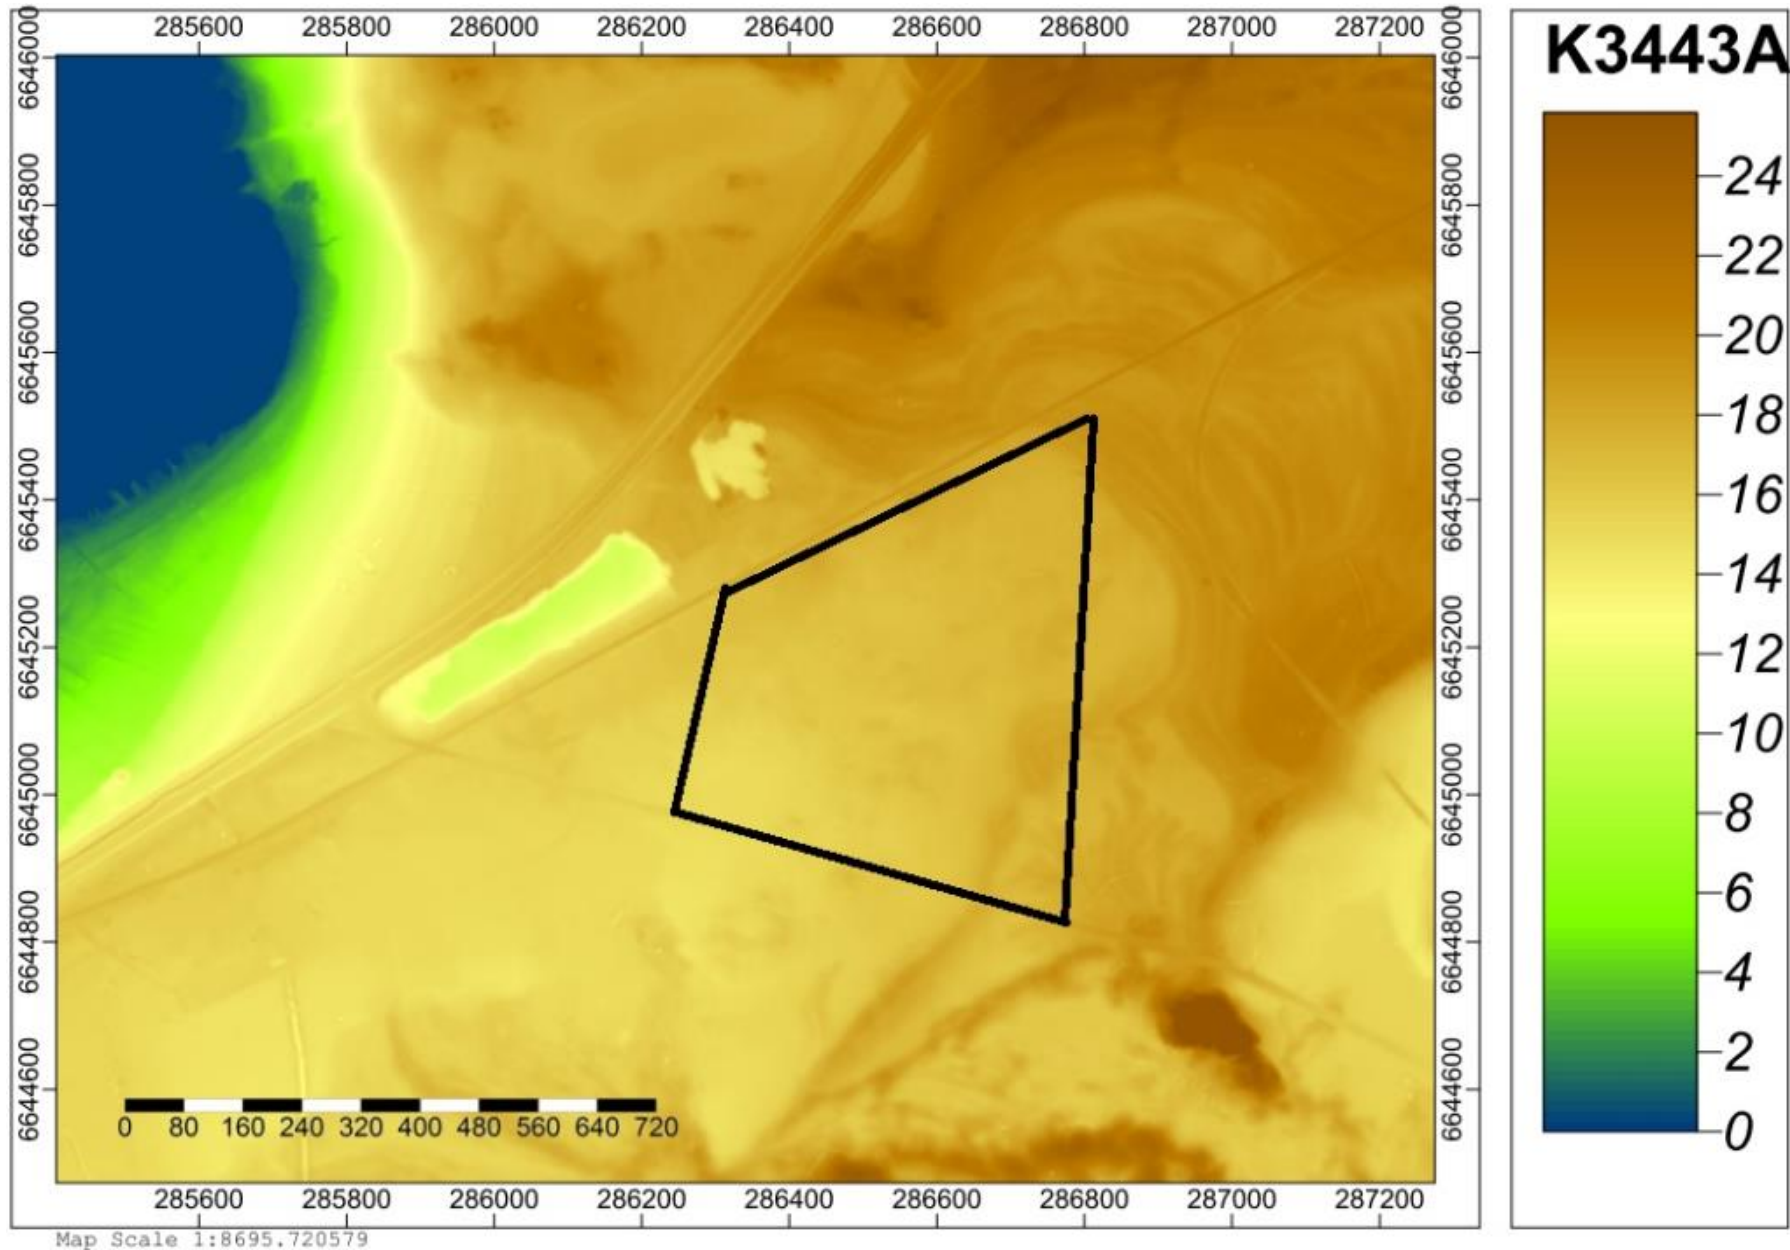


# Utility connections available at the Data Center site

Potable water and sewage water connections are close to data center area.

**Potable water and sewer connections**



# Peaceful seismological environment in Finland

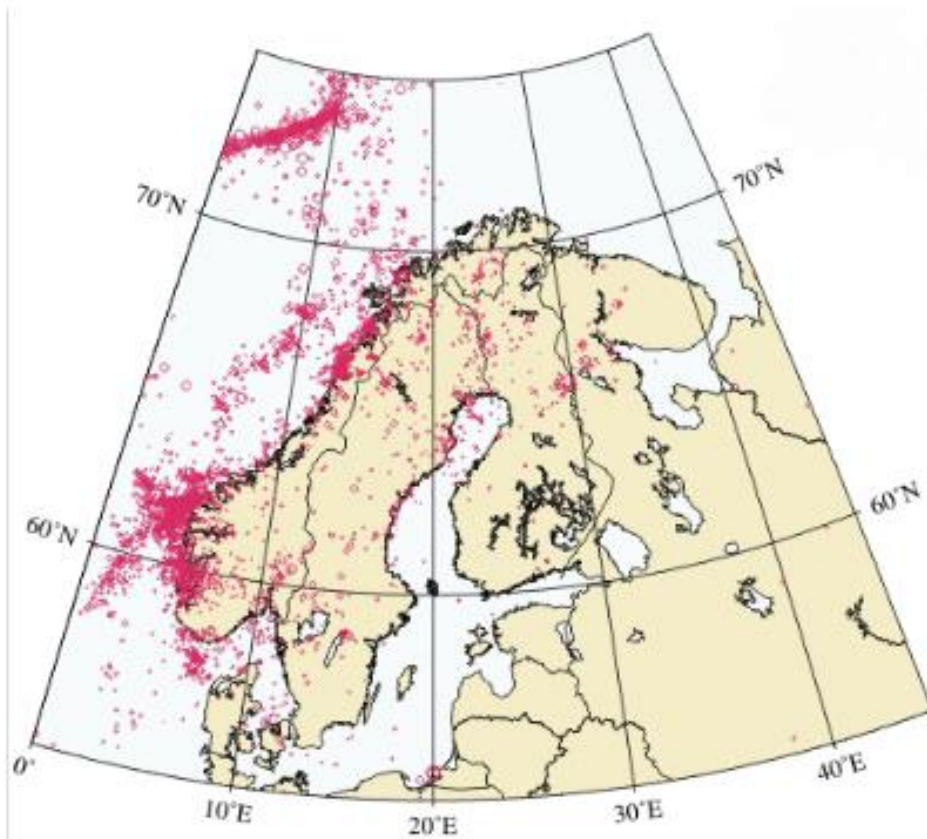

Picture: Earthquakes in Fennoscandia during 1965-2005.

The largest earthquake in the region was in 2006: magnitude 2.1.


- Finland is located in a very peaceful area concerning earthquakes.
- There have been some minor earthquakes also in Hanko area, but the magnitude of those events has been small.
- Minor earthquakes in Finland are part of interplate earthquake series on Eurasian tectonic plate.
- Due to the fact that there have been only minor earthquakes, they are not required to be taken in to account in any local building regulations or codes.

# Peaceful seismological environment in Finland

List of all recorded earthquakes in the 50 km radius from the Hanko Koverhar data center site since 2000.

#	Year	Mnt	Day	Time (UTC)	Lat. (°)	Lon. (°)	Dist. (km)	Max. mag.	Depth (km)
1	2016	5	20	01:25:58.0	59.803	22.477	41,5	0.6 (LH)	5.0 <sup>F</sup>
2	2014	4	22	19:22:55.3	59.940	23.531	19,4	0.9 (LH)	2.0 <sup>F</sup>
3	2014	3	31	23:06:00.4	59.956	23.536	20,4	1.1 (LH)	5.0 <sup>F</sup>
4	2007	1	10	19:45:05.5	59.961	22.683	*30,5	1.0 (L)	4.0 <sup>F</sup>
5	2006	10	3	21:02:22.3	59.901	22.969	*13,4	1.5 (L)	3.0 <sup>F</sup>
6	2006	8	16	18:23:46.1	59.948	22.980	14,8	2.1 (LN)	5.0 <sup>F</sup>
7	2004	2	23	21:46:57.8	59.912	23.791	32,9	1.1 (L)	3.0

Magnitudes are local magnitudes in ML scale (the Richter scale) based on readings from Finnish BBZ/SPZ stations

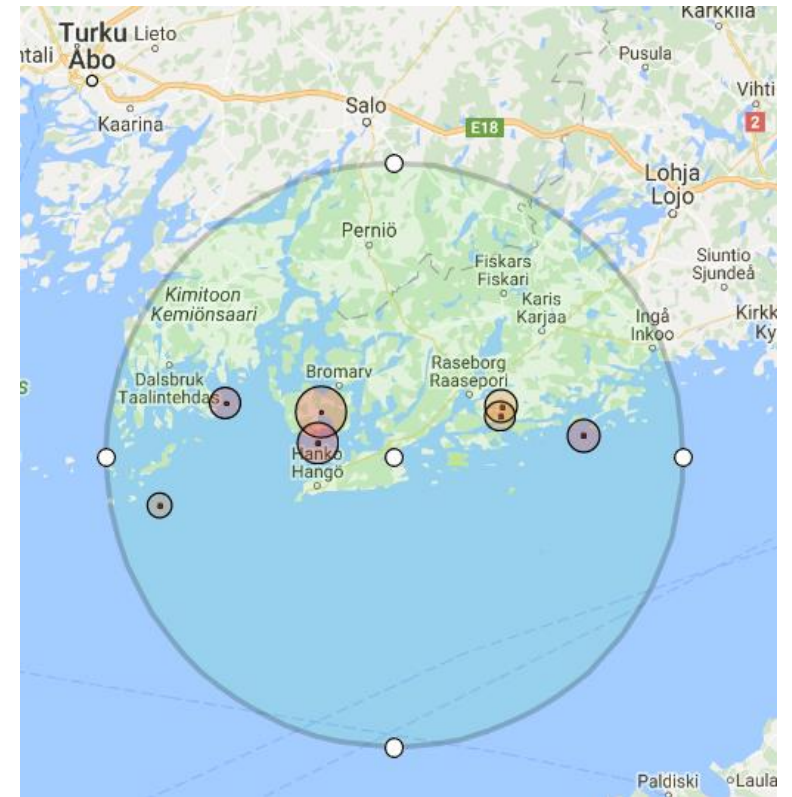




# POWER SUPPLY

# National power grid connection (110 and 400 kV)

## FINGRID POWER TRANSMISSION NETWORK

1.1.2015


- 400 kV grid
- 220 kV grid
- 110 kV grid
- HVDC
- network owned by others

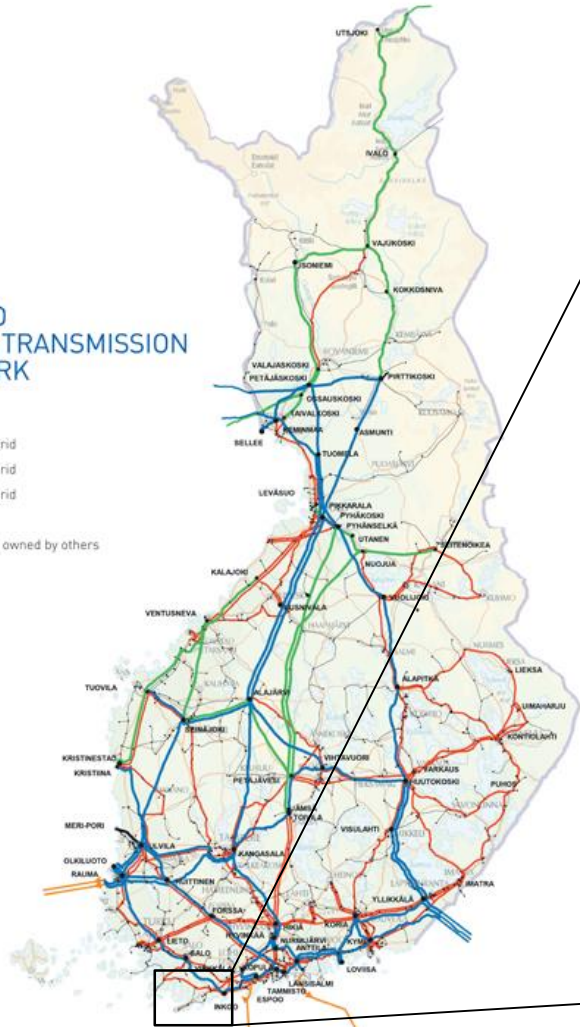

110 kV regional network in Hanko - Raasepori area (ongoing upgrade in yellow colour)



# Hanko electrical grid

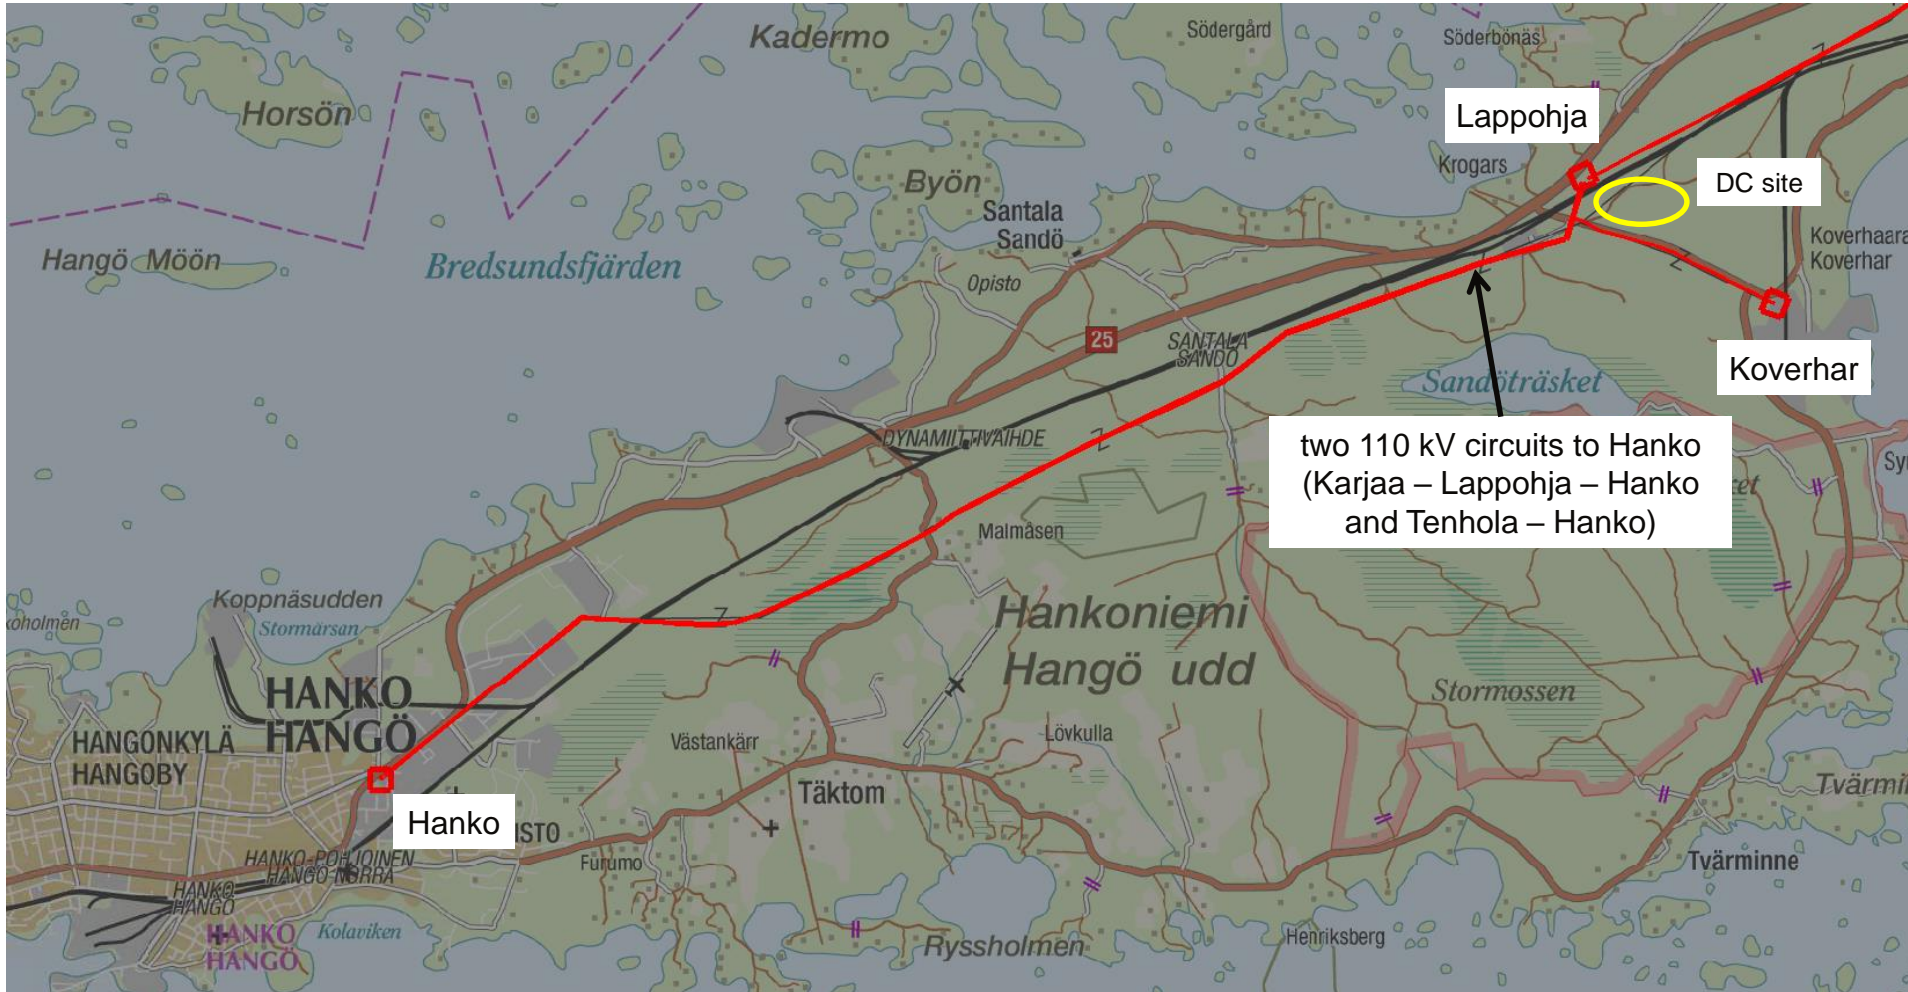

# Power ramp up to Hanko Data Center site; phase 1


## Phase 1 10 MW

Required investment

- 10 MW double supply 20 kV cables
- 20 kV switchgear on site

Time needed 6 months

Cost estimation 0,5 M€

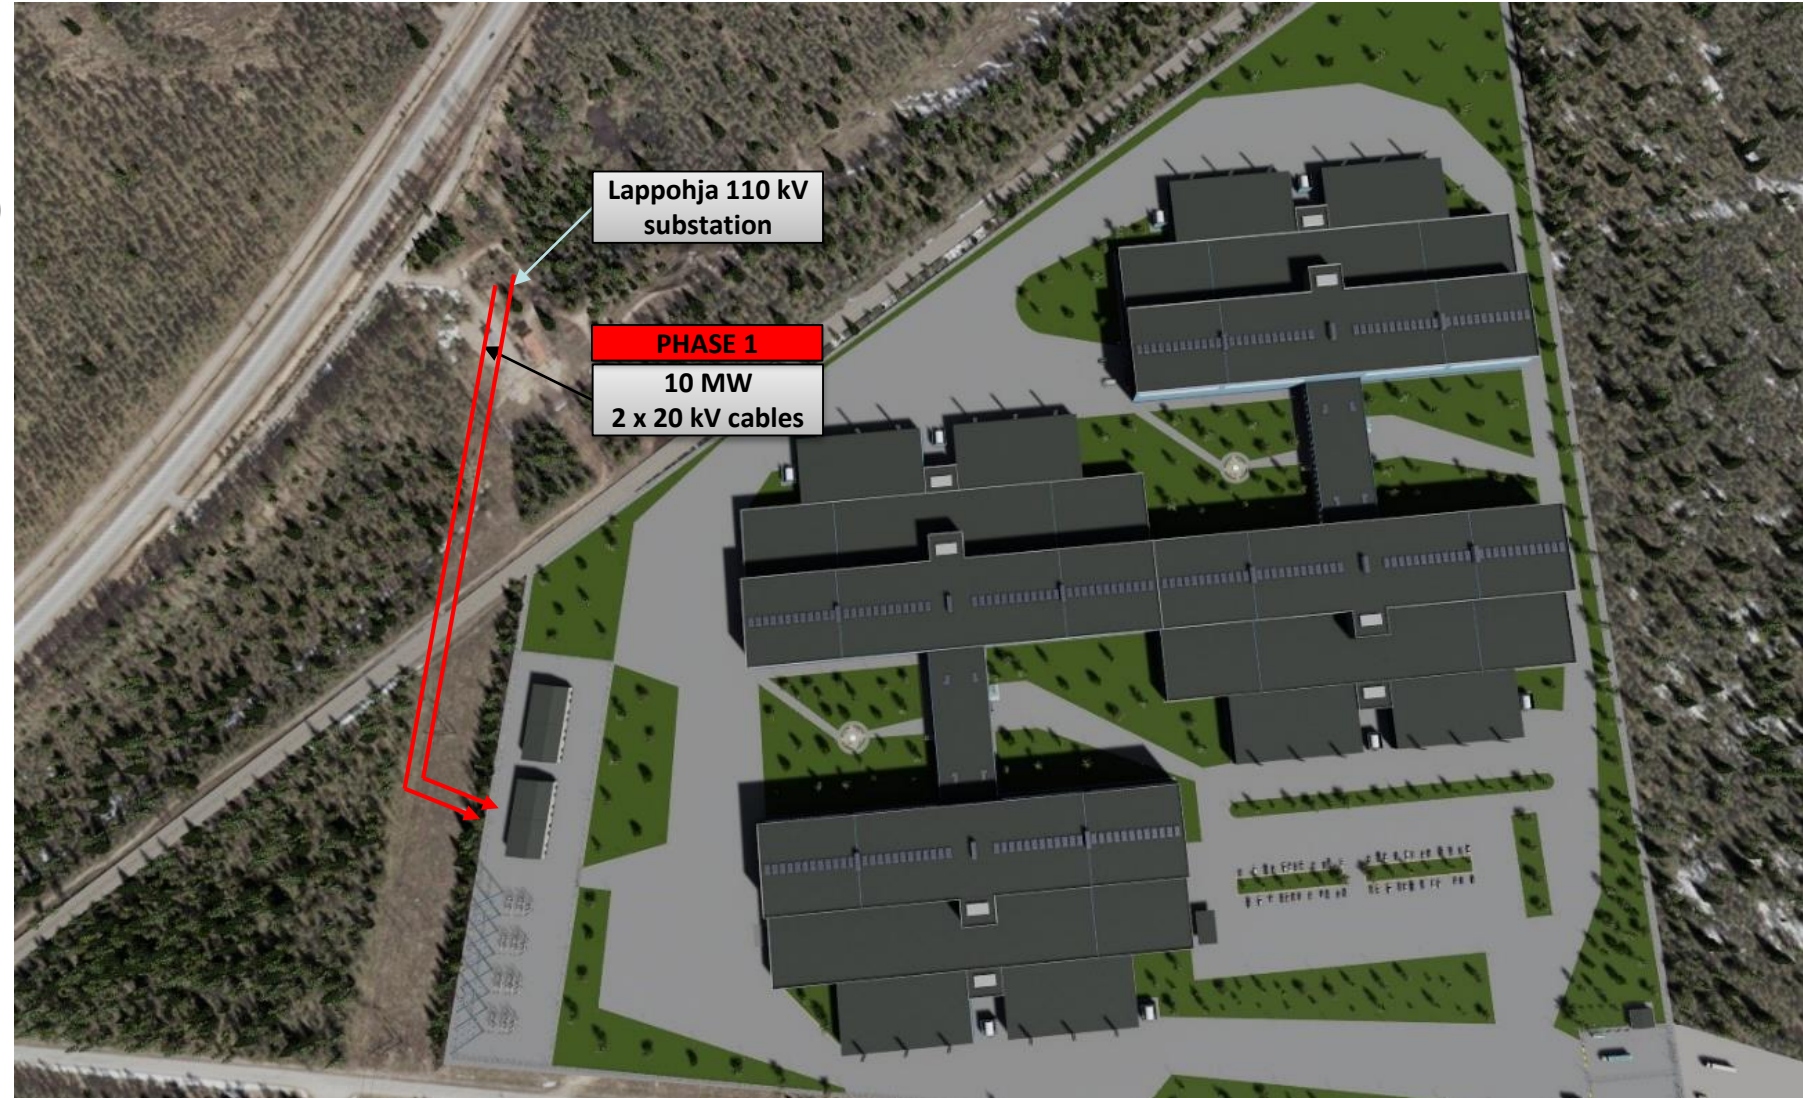

# Power ramp up to Hanko Data Center site; phase 2


## Phase 2 30 MW

### Required investment

- 110 kV cable
- 110 kV switchgear on site
- 20 kV extension
- 110/20 kV transformer
- 20 kV cables are redundant feed

Time needed 18 -24 months

Cost estimation 1,5 M€

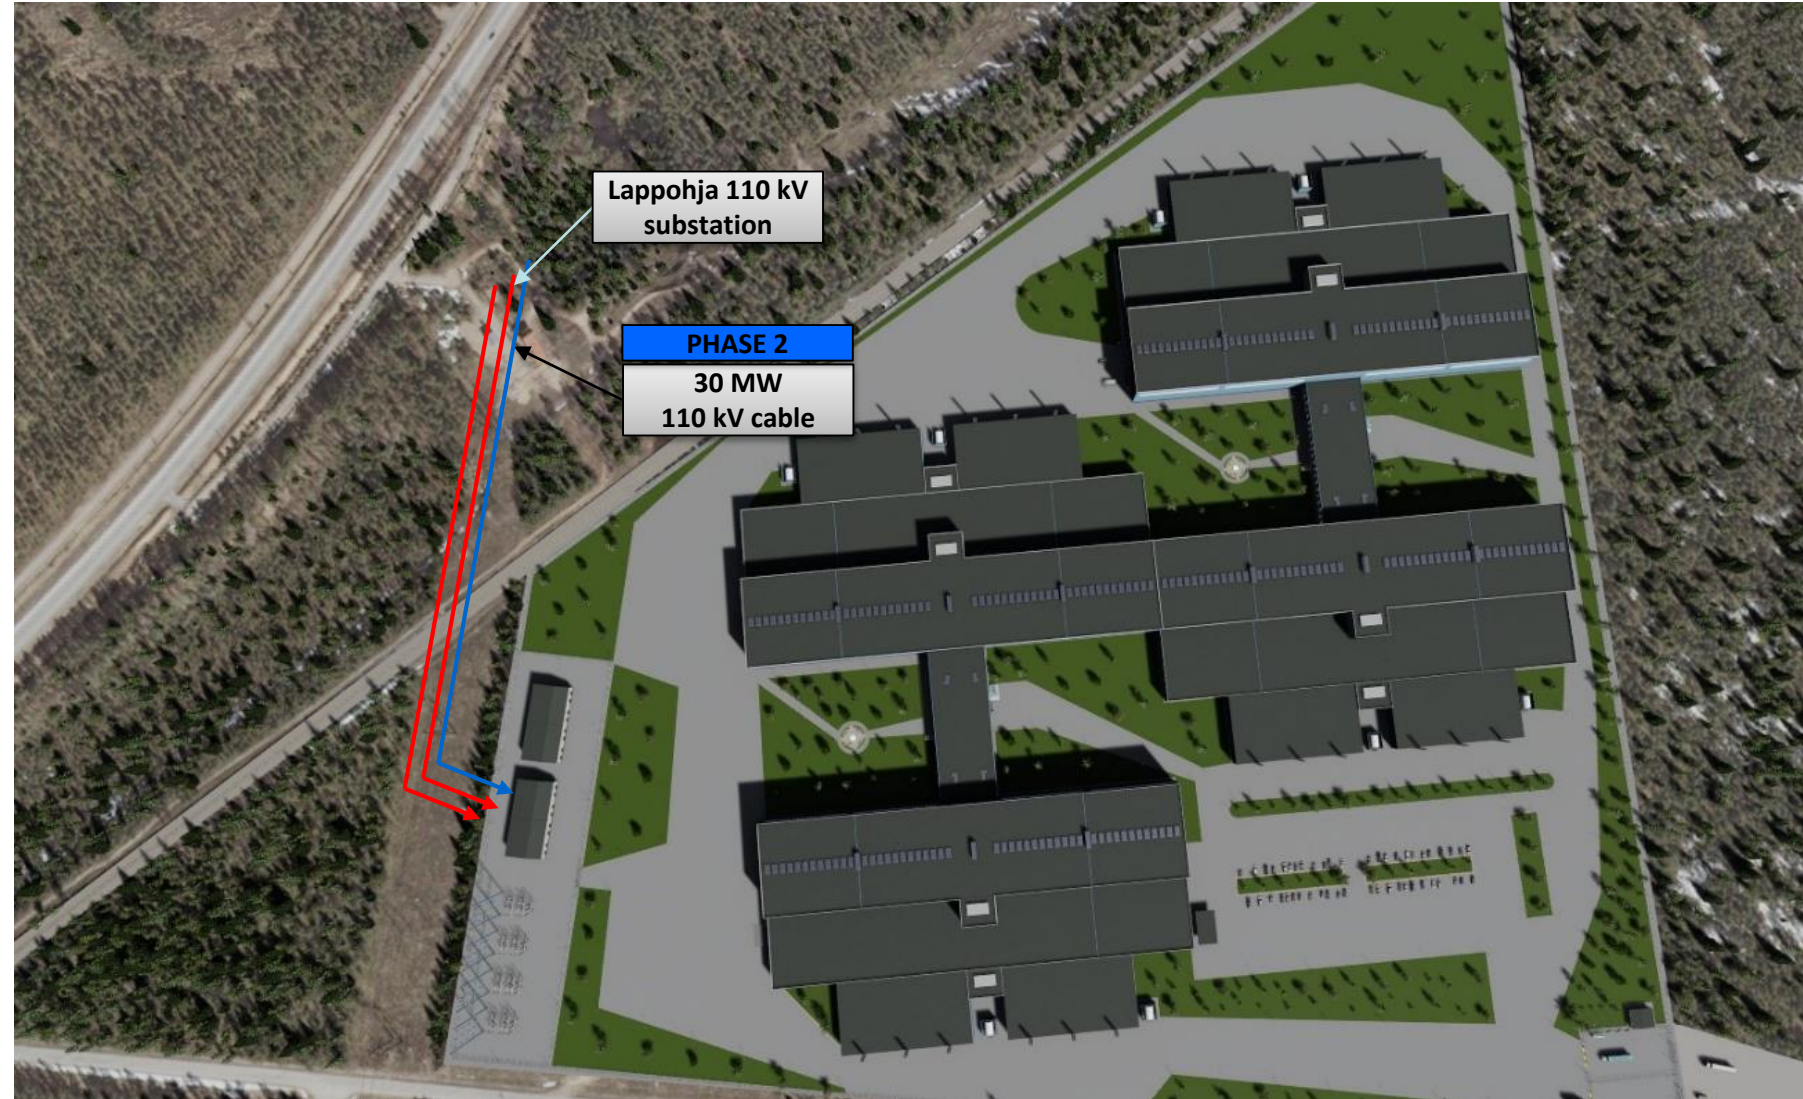

# Power ramp up to Hanko Data Center site; phase 3

## Phase 3 100 - 200 MW,

### Required investment

- New 110 kV cable
- 110 kV switchgear extension on site
- 20 kV extension
- 110/20 kV transformer

Time needed 36 - 60 months

Cost estimation 2,2 M€




# Power ramp up to Hanko Data Center site; phase 3 Local 110 kV network upgrades

## Phase 3 100 - 200 MW,

Required investment to the local 110 kV network

- Karjaa new 110 kV connection
- New 110 kV line Karjaa - Tenhola
- Upgrade 110 kV line Tenhola – Lappohja
- Lappohja 110 kV substation extension


Time needed 36 - 60 months

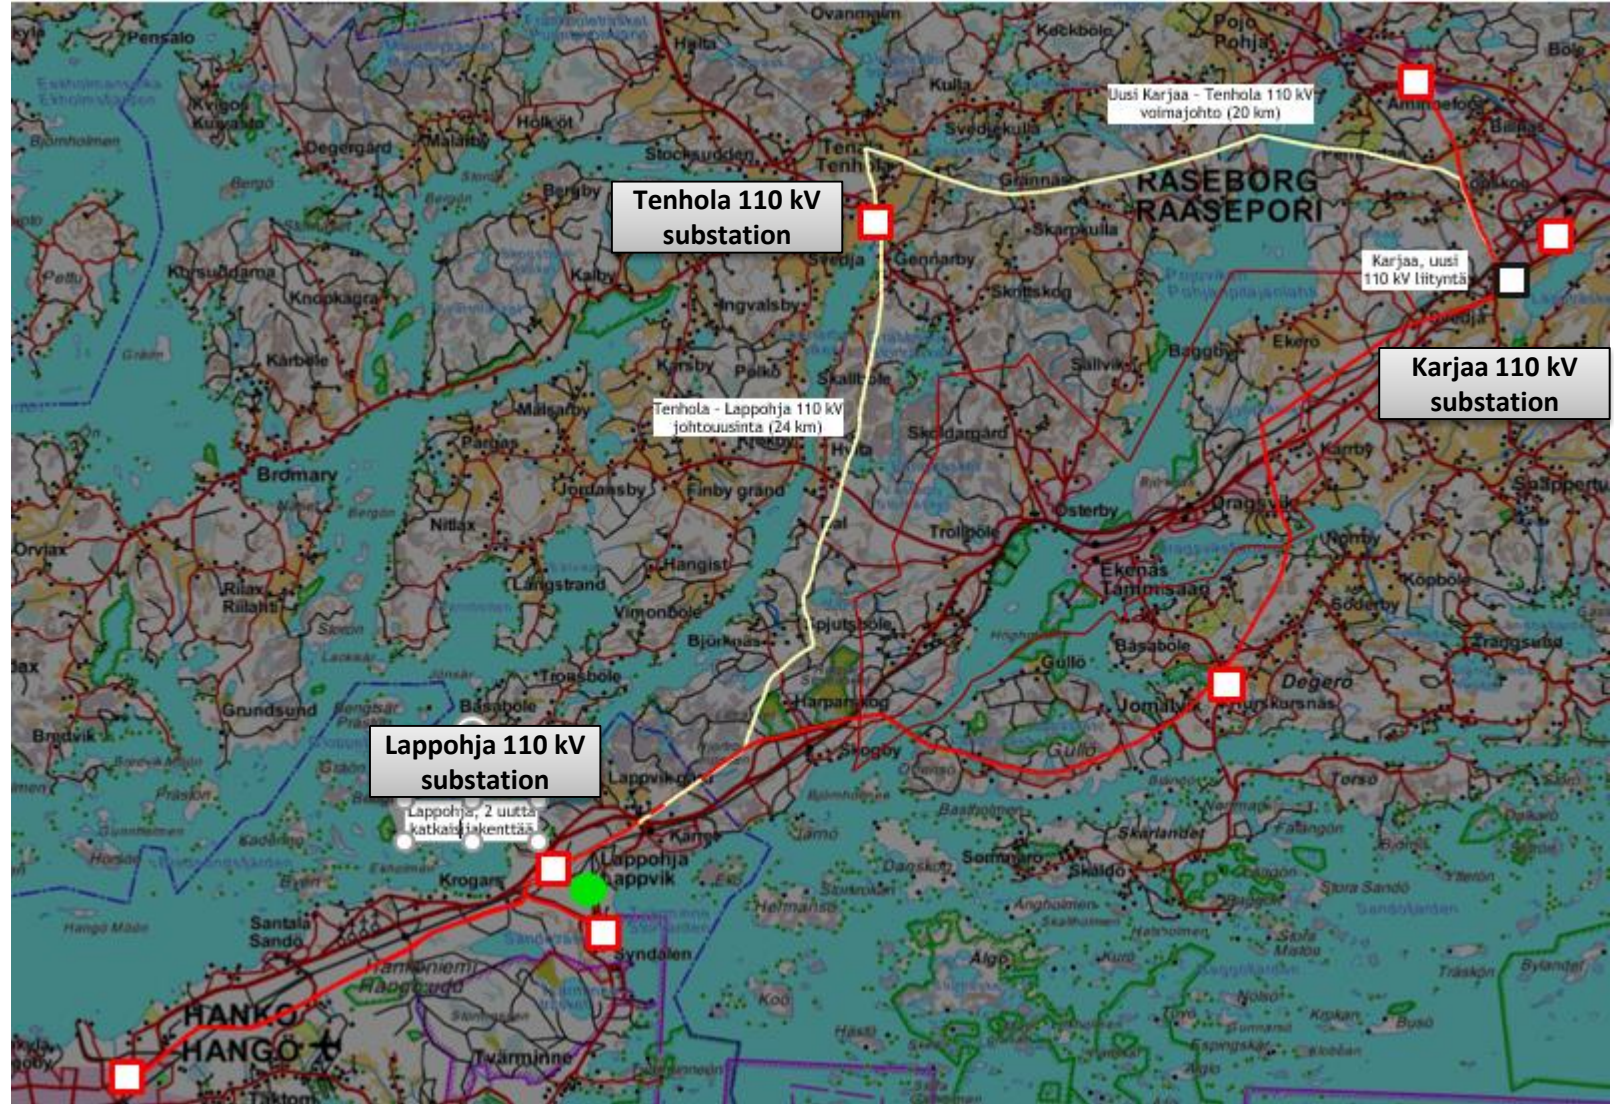




# CONNECTIVITY

# Hanko Data Center global connectivity

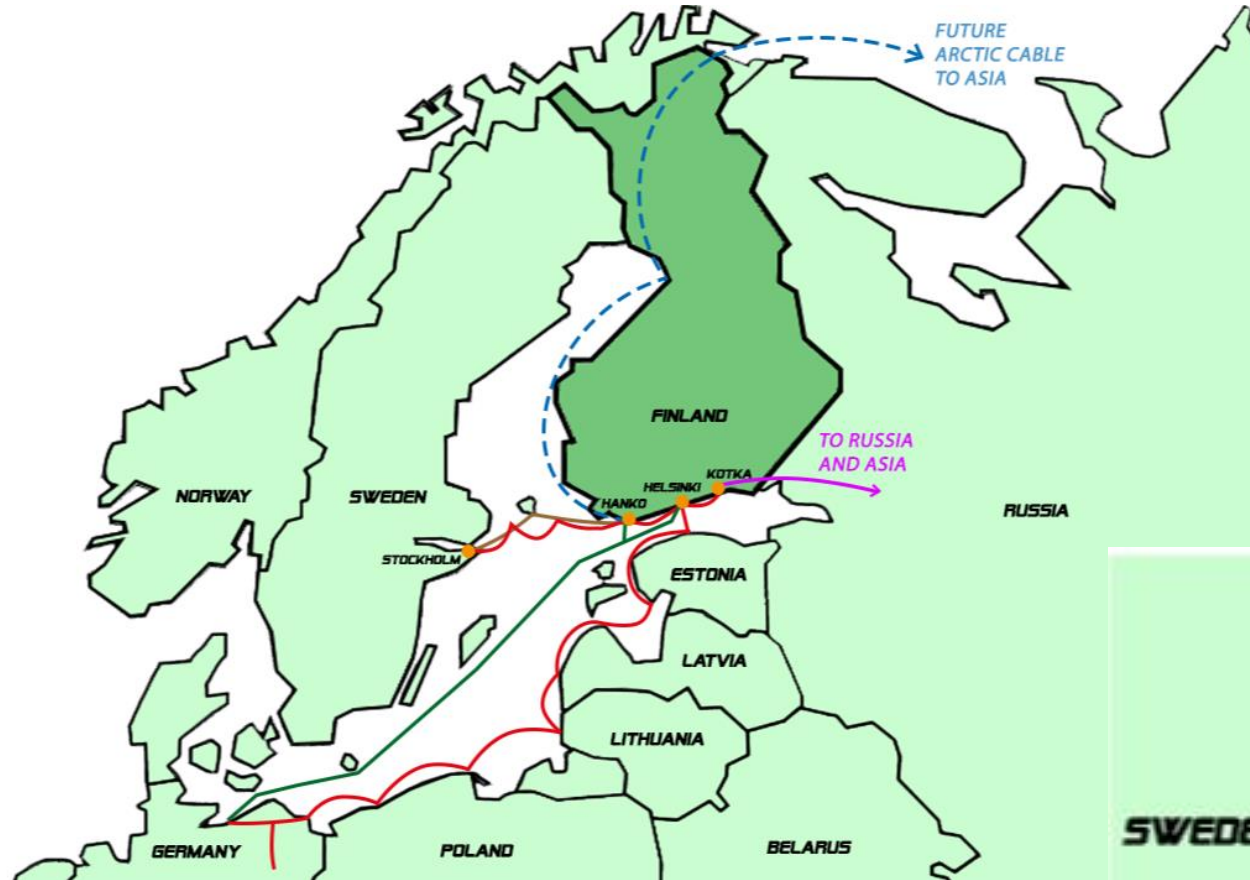

# Hanko Data Center global connectivity

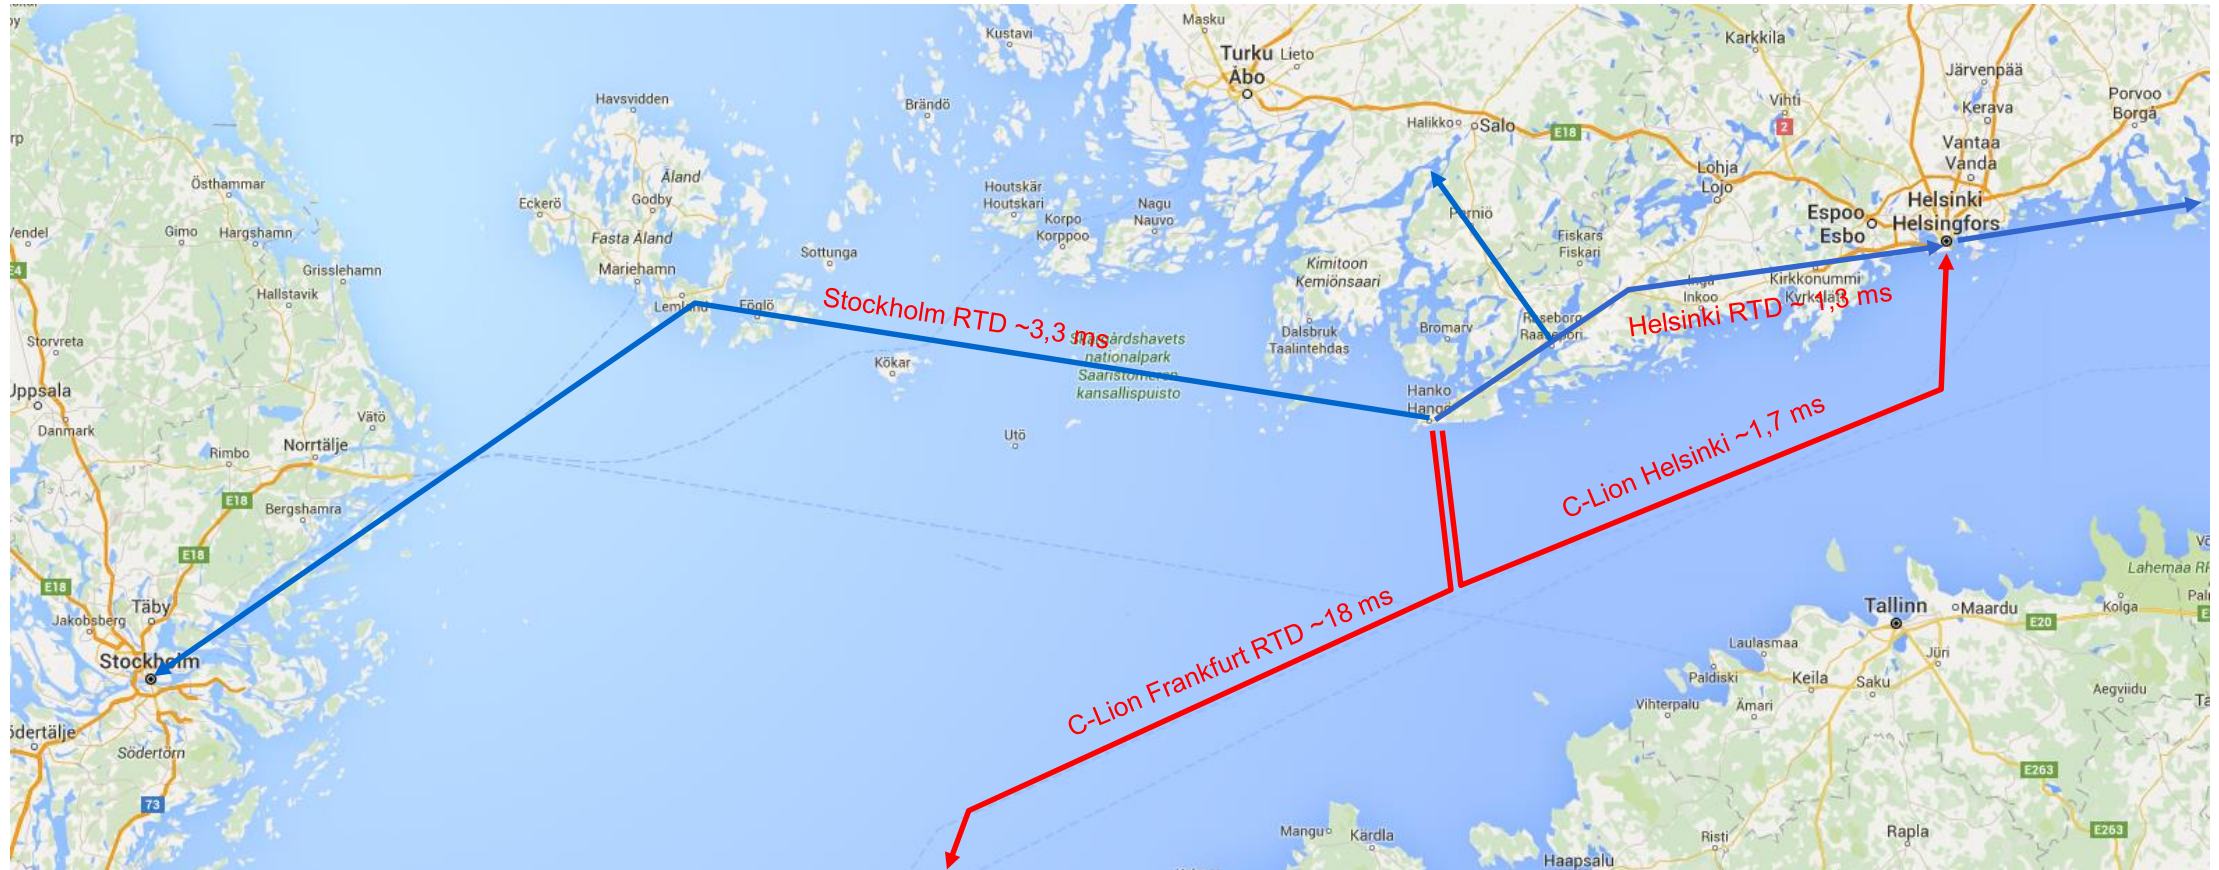

# Hanko Data Center local connectivity



# Example of Round Trip Delay

A-end	B-end	Distance	Estimated latency RTD
Hanko Koverhar DC	Helsinki PoP	~125 km	~1,25 ms
Hanko Koverhar DC	Finnish Russian border	~360 km	~3,6 ms
Hanko Koverhar DC	*Hamburg PoP	~1460 km	~14,6 ms
Hanko Koverhar DC	*Frankfurt PoP	~1970 km	~19,7 ms
Hanko Koverhar DC	ST Petersburg	~635 km	~6,4 ms
Hanko Koverhar DC	Moscow	~1140 km	~11,4 ms


\* RTD calculated using Cinia SeaLion1 via Hanko branching

# COOLING AND SECONDARY HEAT REUSE


# Conditions support effective cooling

- Ambient conditions suitable for free cooling
- Ambient air  $>25\text{ }^{\circ}\text{C}$   $<19\text{ h/year}$  (average 2012 – 2014)
- Potential cooling methods: direct air cooling with or without adiabatic cooling, cooling towers, sea water
- Energy re-use possible

Sea water temperature and temperature stability,  
Data: daily averages, Hanko/Pikku Kolalahti 2010-2014,  
Missing data replaced by annual average of existing data

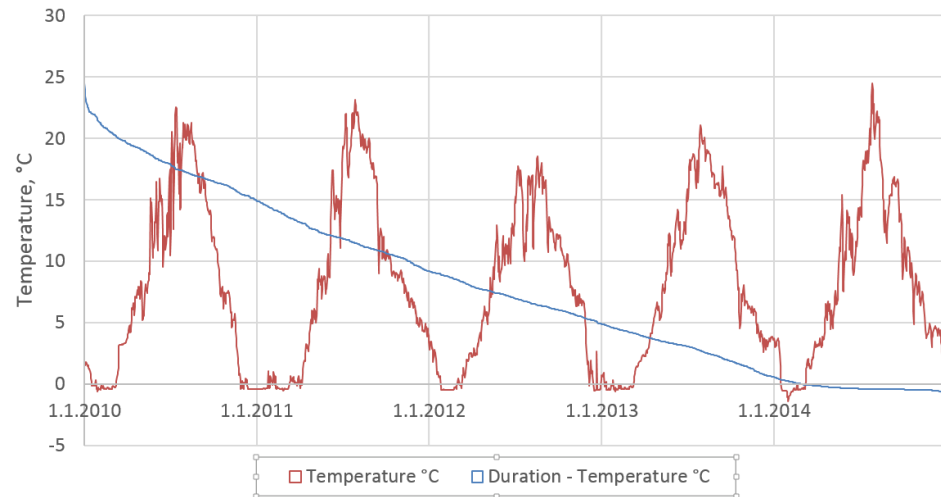


Ambient air: dry temperature and  
duration of dry and wet bulb temperatures  
Air data: hourly averages, Hanko/Tulliniemi 2012-2014 by FMI

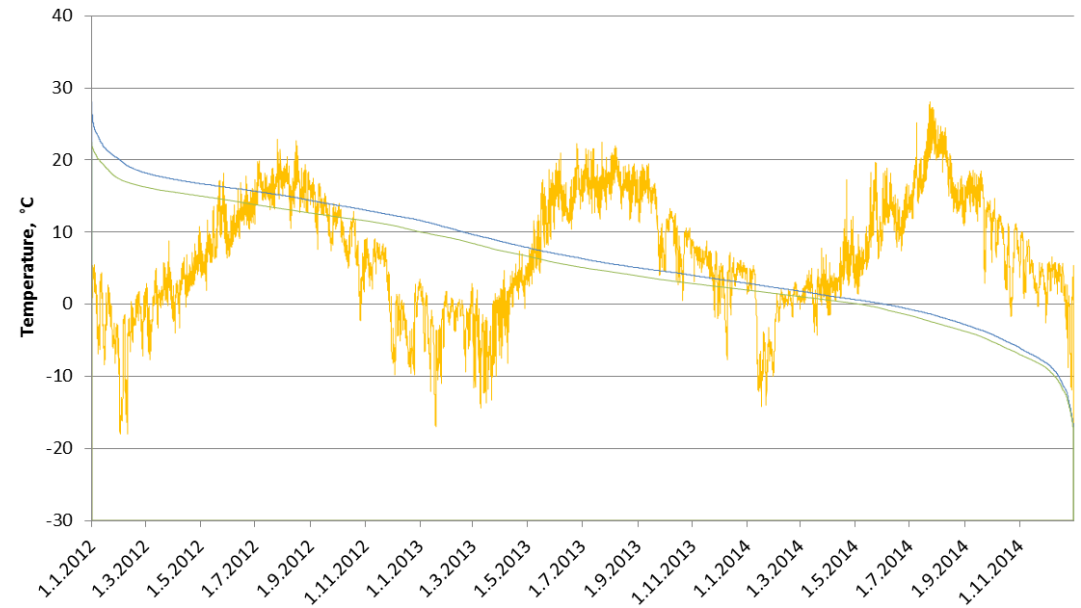


# Cooling by Sea Water

- High free cooling share for white space temperature 21 °C and above
- Cool sea water available from basin near the sea shore
- Sea water stays reasonably cool also in summer. Thus high free cooling energy share.

Sea water average temperature and temperature duration and estimated temperature in 25 m depth. Annual averages Hanko/Pikku Kolahahti 2010 – 2014

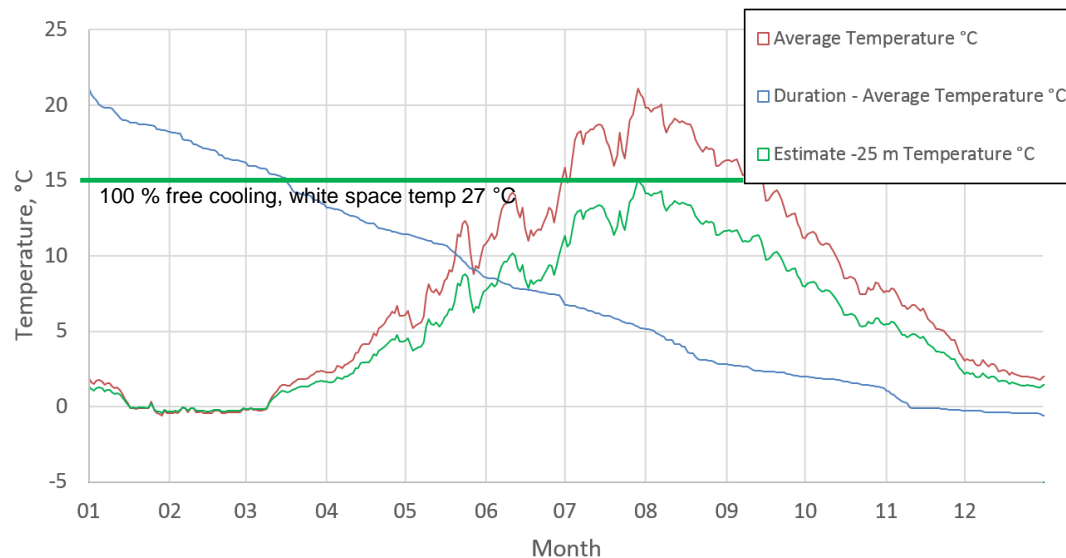


Cooling production by sea water and mechanical cooling  
White space temperatures 27 and 25 °C,  
Data: Average surface temp. from available data, 2010-2014

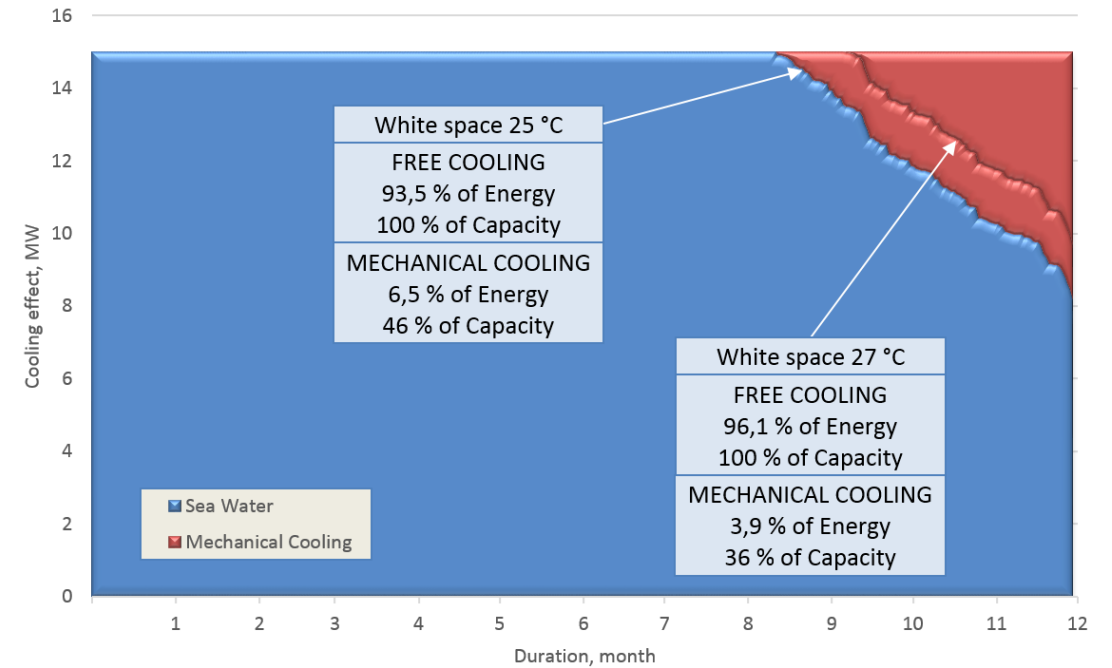

<b>Target white space temp</b>	<b>27 °C</b>	<b>25 °C</b>	<b>21 °C</b>
<b>Primary water circ temp.</b>	<b>17 °C</b>	<b>15 °C</b>	<b>11 °C</b>
<b>Free cooling, energy</b>	<b>96%</b>	<b>93%</b>	<b>86%</b>
<b>Mech. cooling capacity</b>	<b>36%</b>	<b>46%</b>	<b>66%</b>



# 100% free cooling possibility with sea water cooling

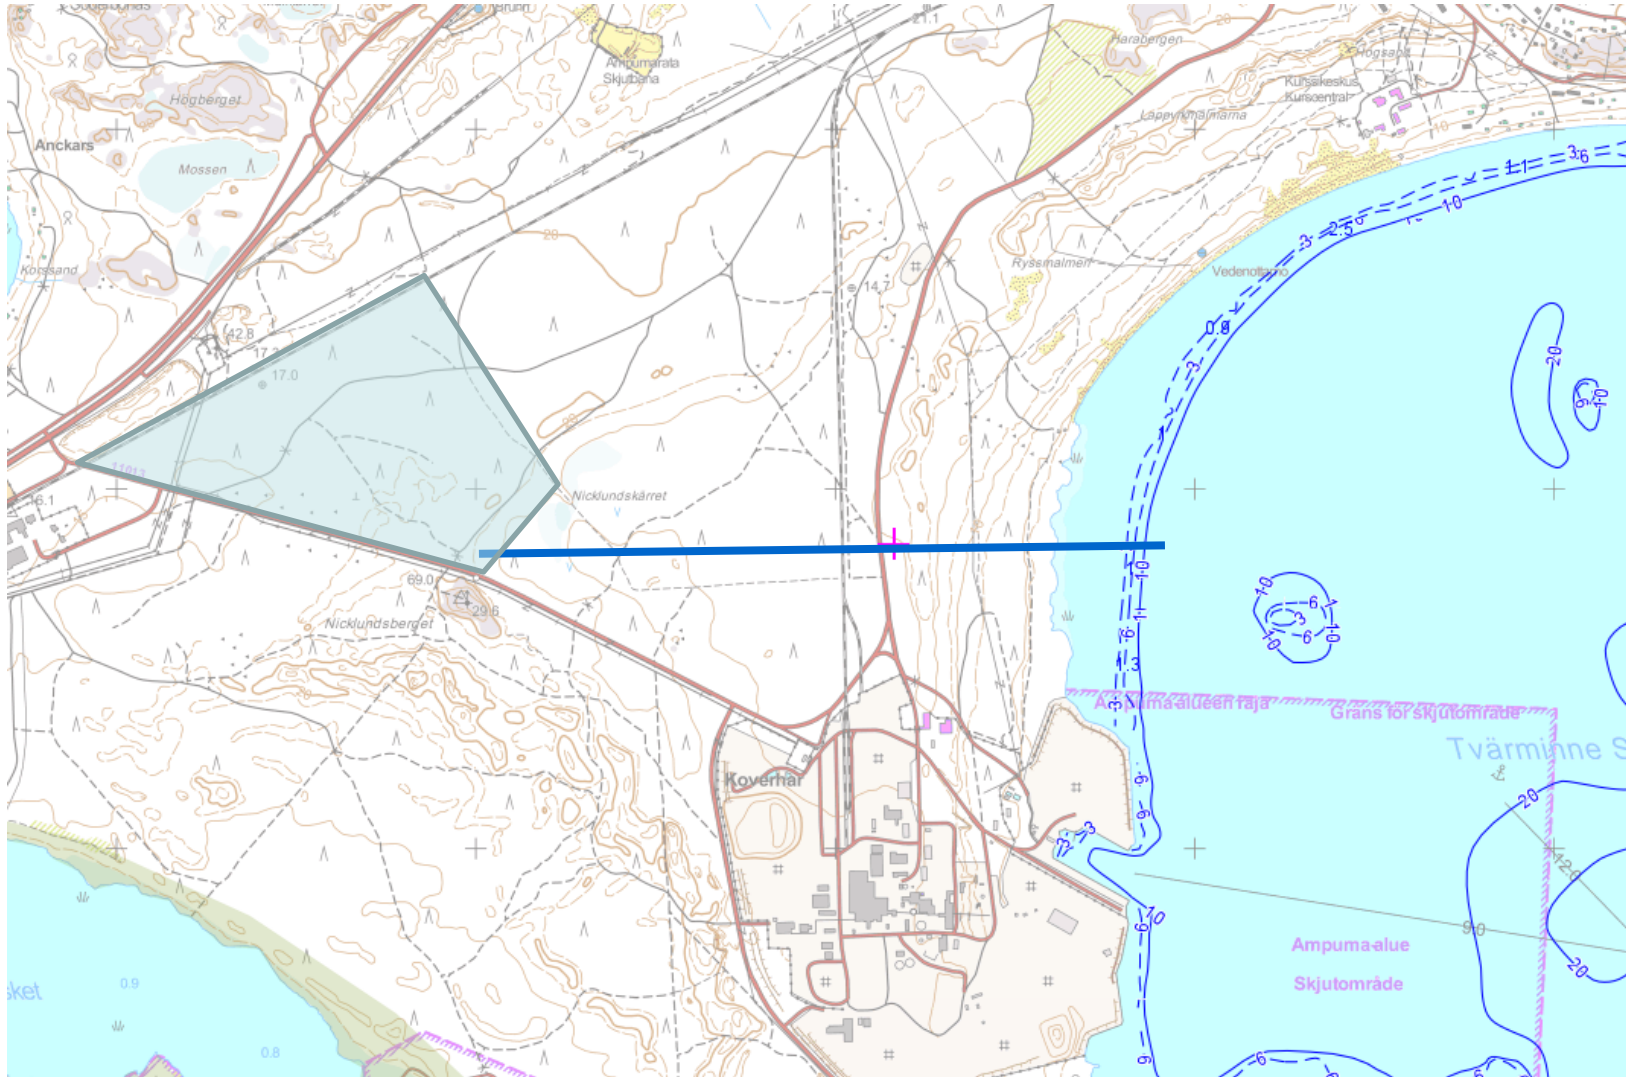


The depth chart of the nearby sea looks promising for achieving 100% free cooling by using cold sea water for data center cooling.


# Cooling Towers and Mechanical Cooling

- Wet bulb temperature favours cooling towers
- High free cooling share for white space temp. 21°C and above
- Make-up water is available from sea
- Tower excess water led to storm water system without treatment or via oil-separation

Ambient air temperature and dry and wet bulb temperature duration, Hanko/Tulliniemi, 2012 - 2014

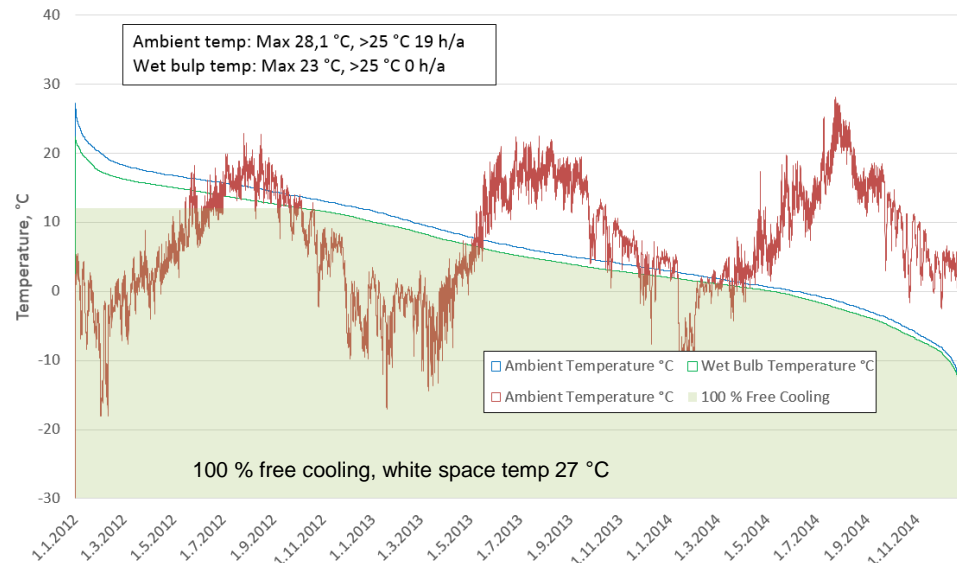


Cooling production by cooling towers and mechanical cooling  
White space temperatures 27 and 25 °C Temp Data 2014

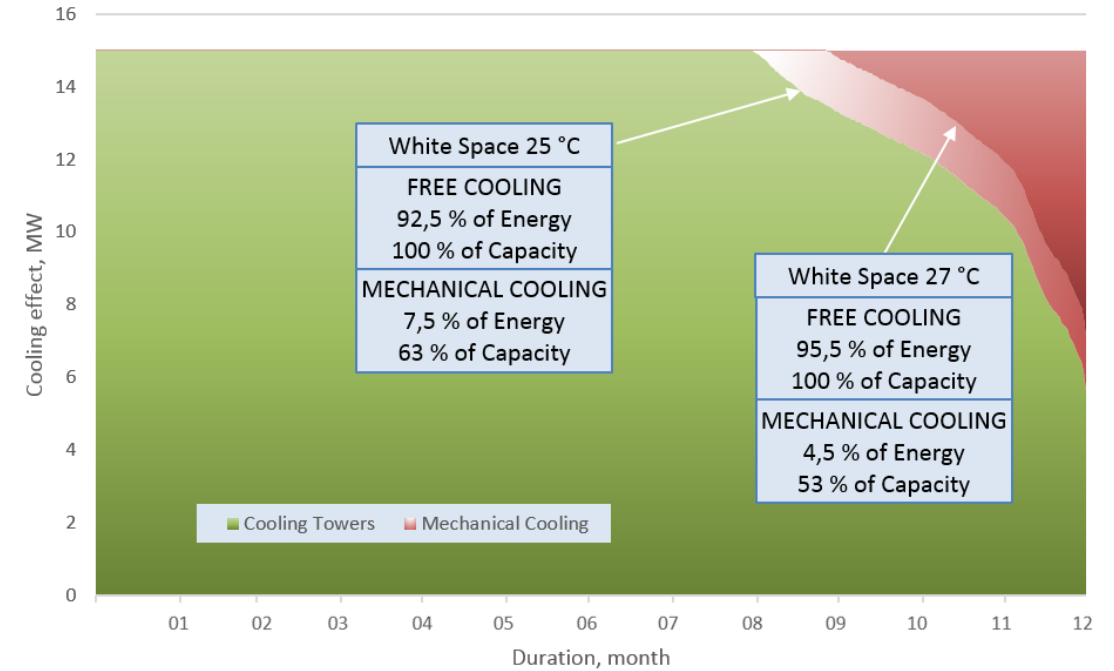

Target white space temp	27 °C	25 °C	21 °C
Primary water circ temp.	17 °C	15 °C	11 °C
Free cooling, energy	96%	93%	85%
Mech. cooling capacity	53%	63%	83%

# Direct Air Cooling




- Ambient conditions suitable for free cooling
- Maximum ambient air temperature 28,1 °C
- Ambient temperature >25 °C <19 h/a (average 2012 - 2014)
  - Longest continuous period 13 h, average peak duration 5,2 h
- With adiabatic cooling (RH 80 %) max temp 25,1 °C

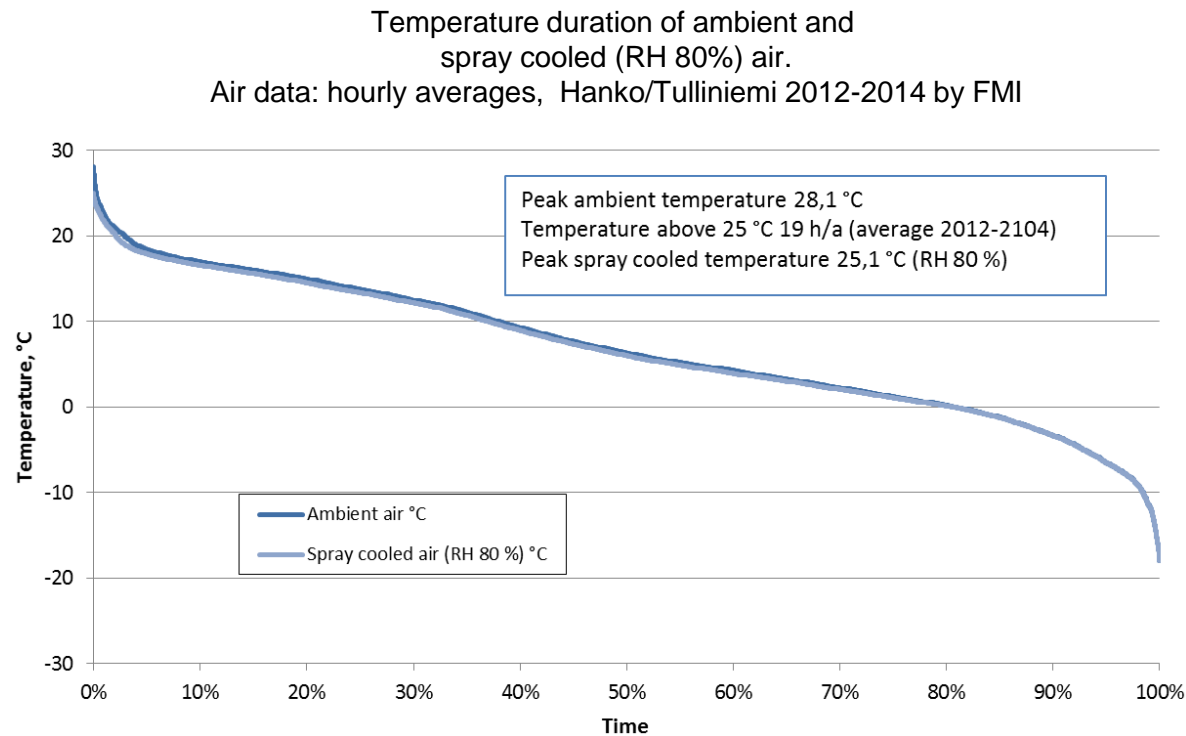

# Mechanical Cooling

- Mechanical cooling (heat pumps/compressors) is necessary
  - Covering summer temperature peaks
  - Backup
  - Raising heat temperature for energy re-use
- Potential heat sinks for heat pumps/compressors
  - Local district heating network (energy re-use)
  - Building heating (energy re-use)
  - Ambient air
  - Sea water
  - Cooling tower circulation
- Dimensioning for summer peak demands or as full backup
- Mechanical cooling energy production share is low even though capacity need can be quite high
- Mechanical cooling EER from 3 up to >7 depending on heat sink
- Potential for energy re-use up to 1,3 x DC power consumption

# Examples of Secondary Heat Re-use Arrangements

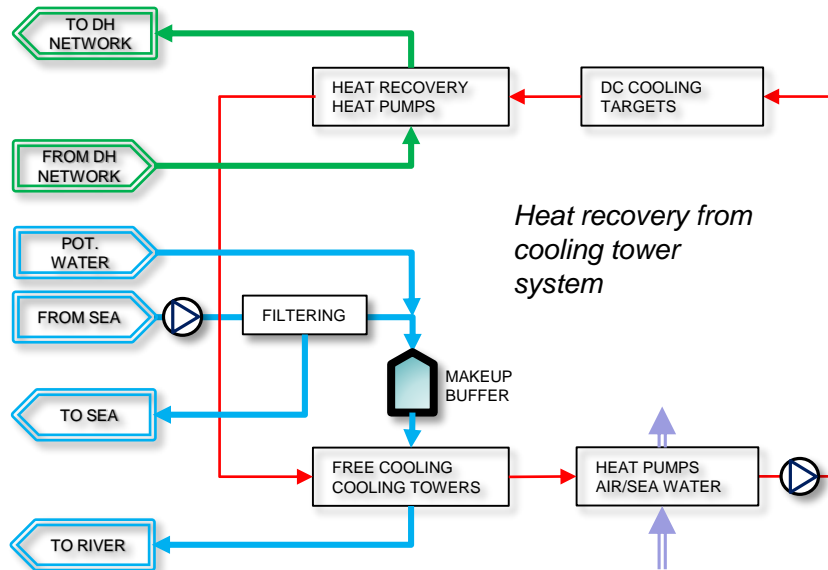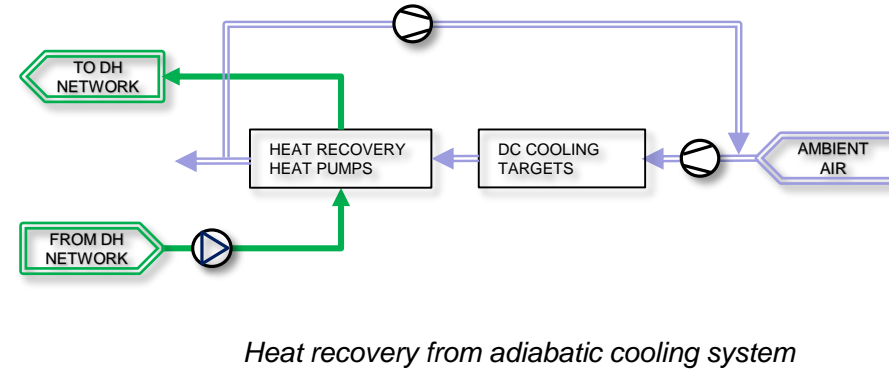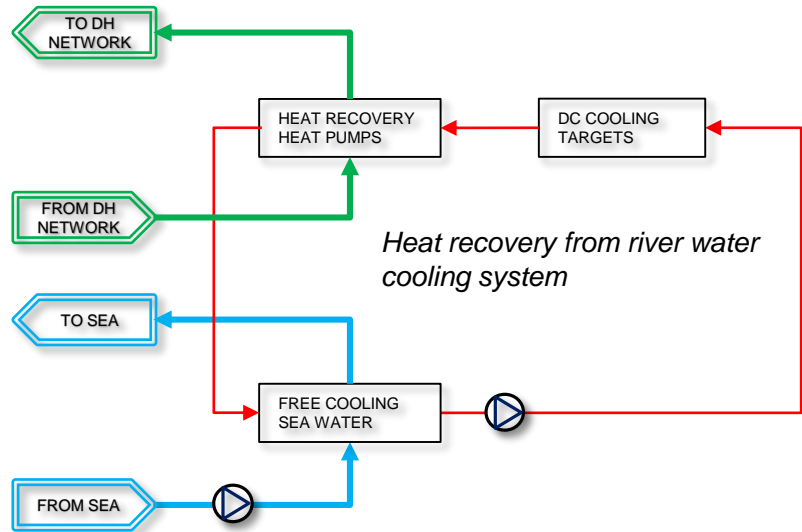

# SITE UTILIZATION

# Air cooling utilization example



# Air cooling utilization example





# Air cooling utilization example



# Air cooling utilization example



# Air cooling utilization example




# Air cooling utilization example



# Air cooling utilization example



# Air cooling utilization example

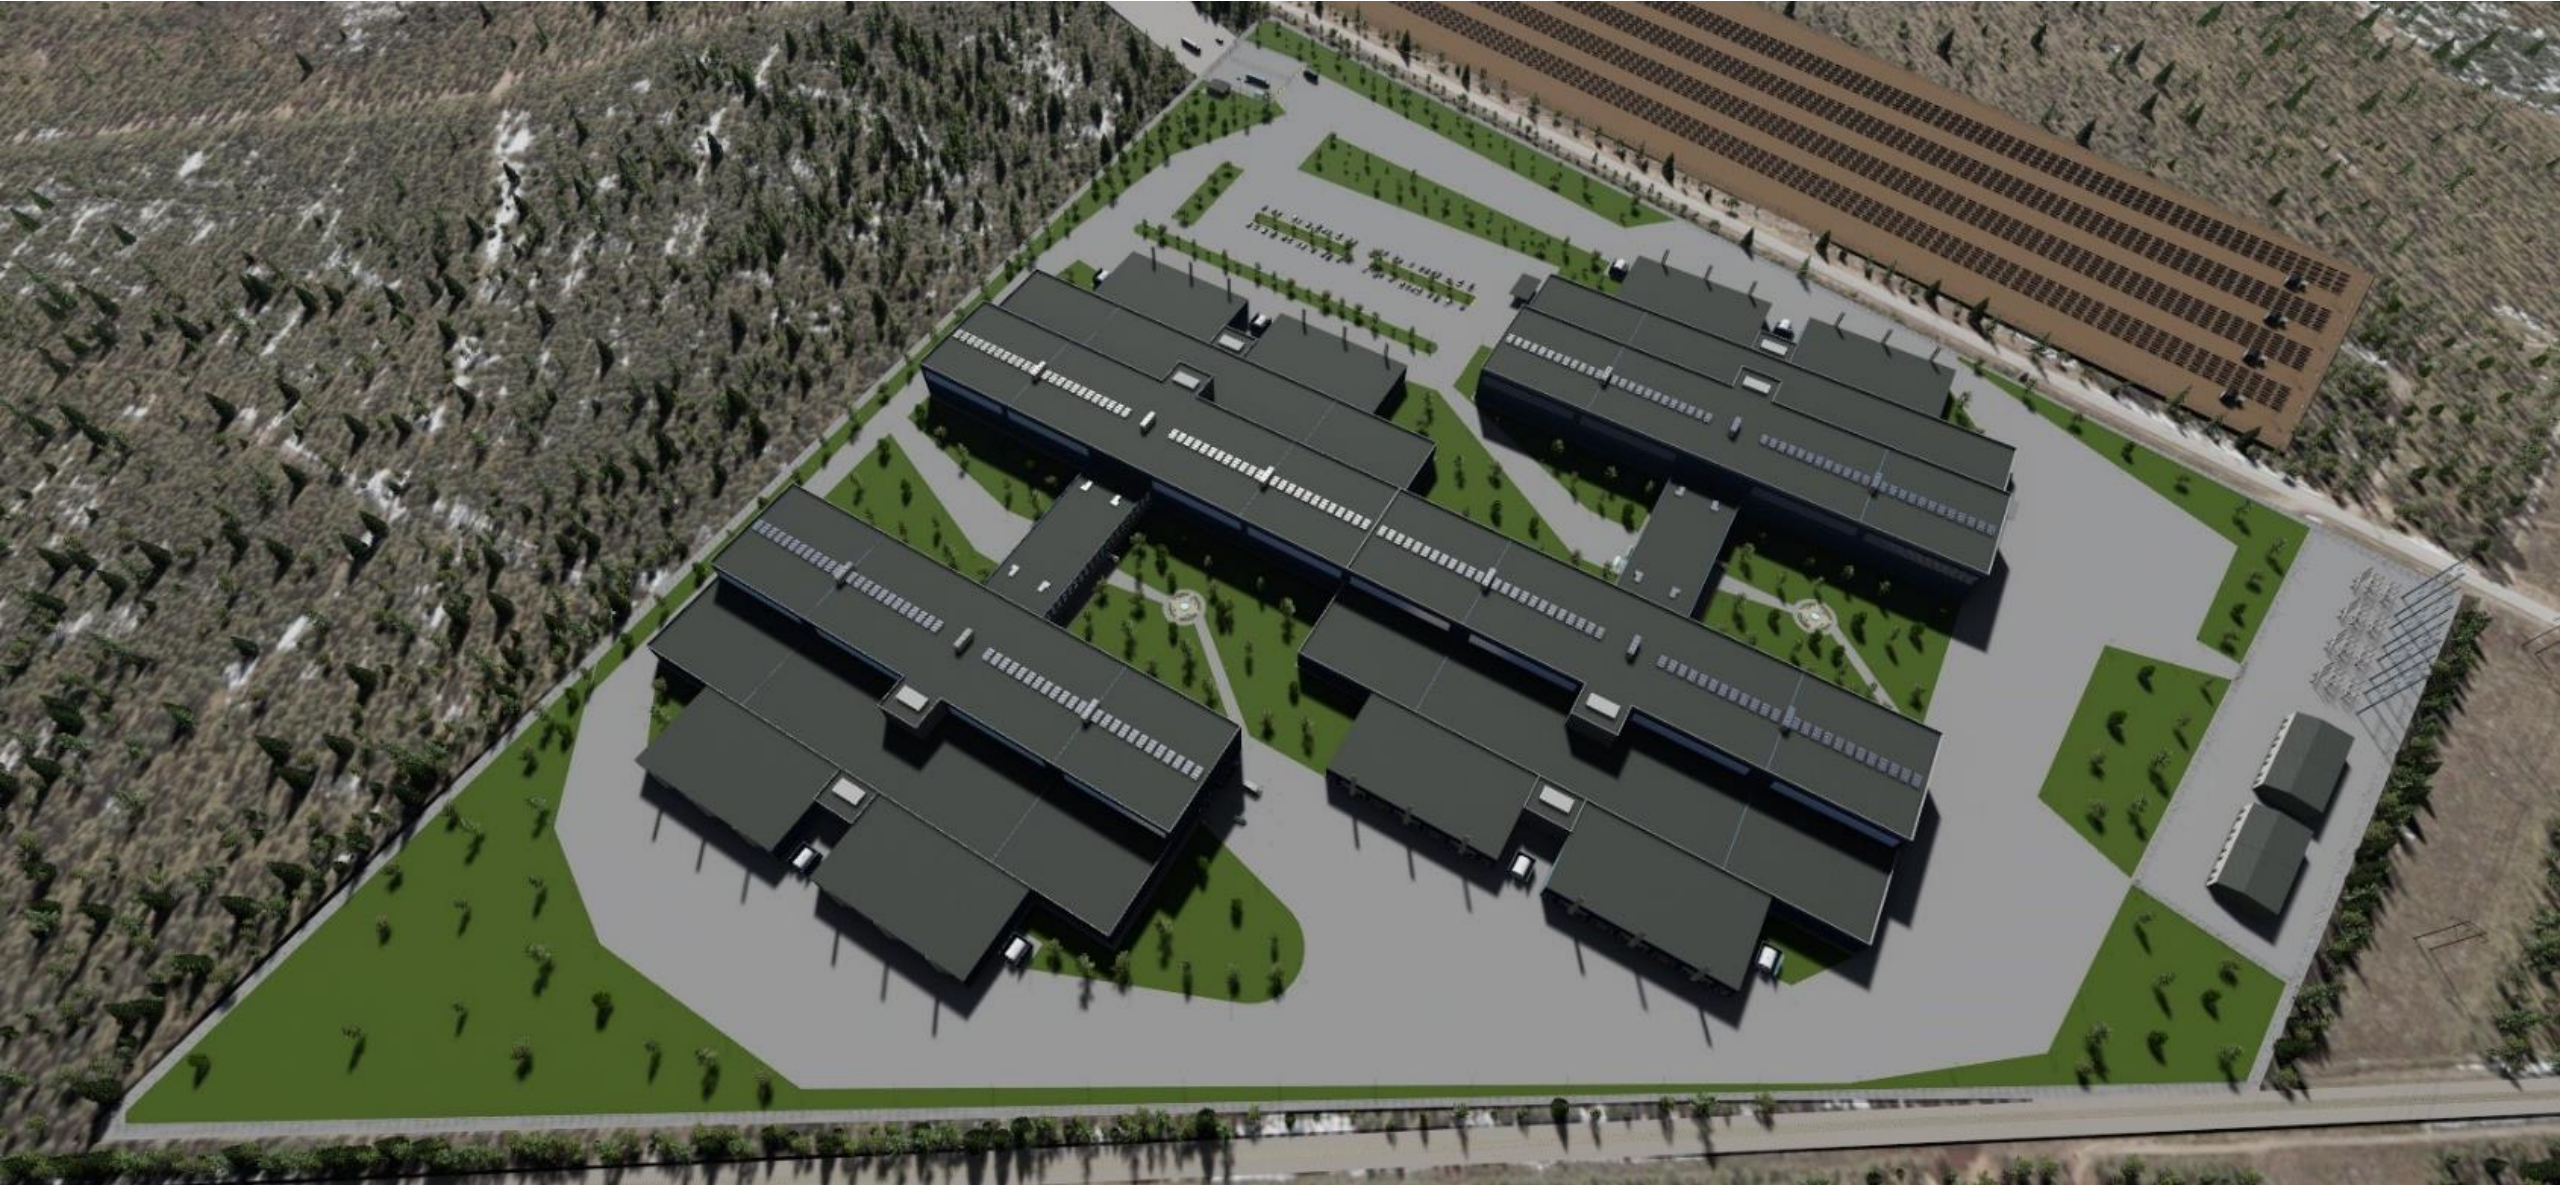

# Air cooling utilization example



# Air cooling utilization example





# Water cooling utilization example



# Water cooling utilization example



# Water cooling example utilization




# Water cooling utilization example



# Water cooling utilization example




# Water cooling utilization example

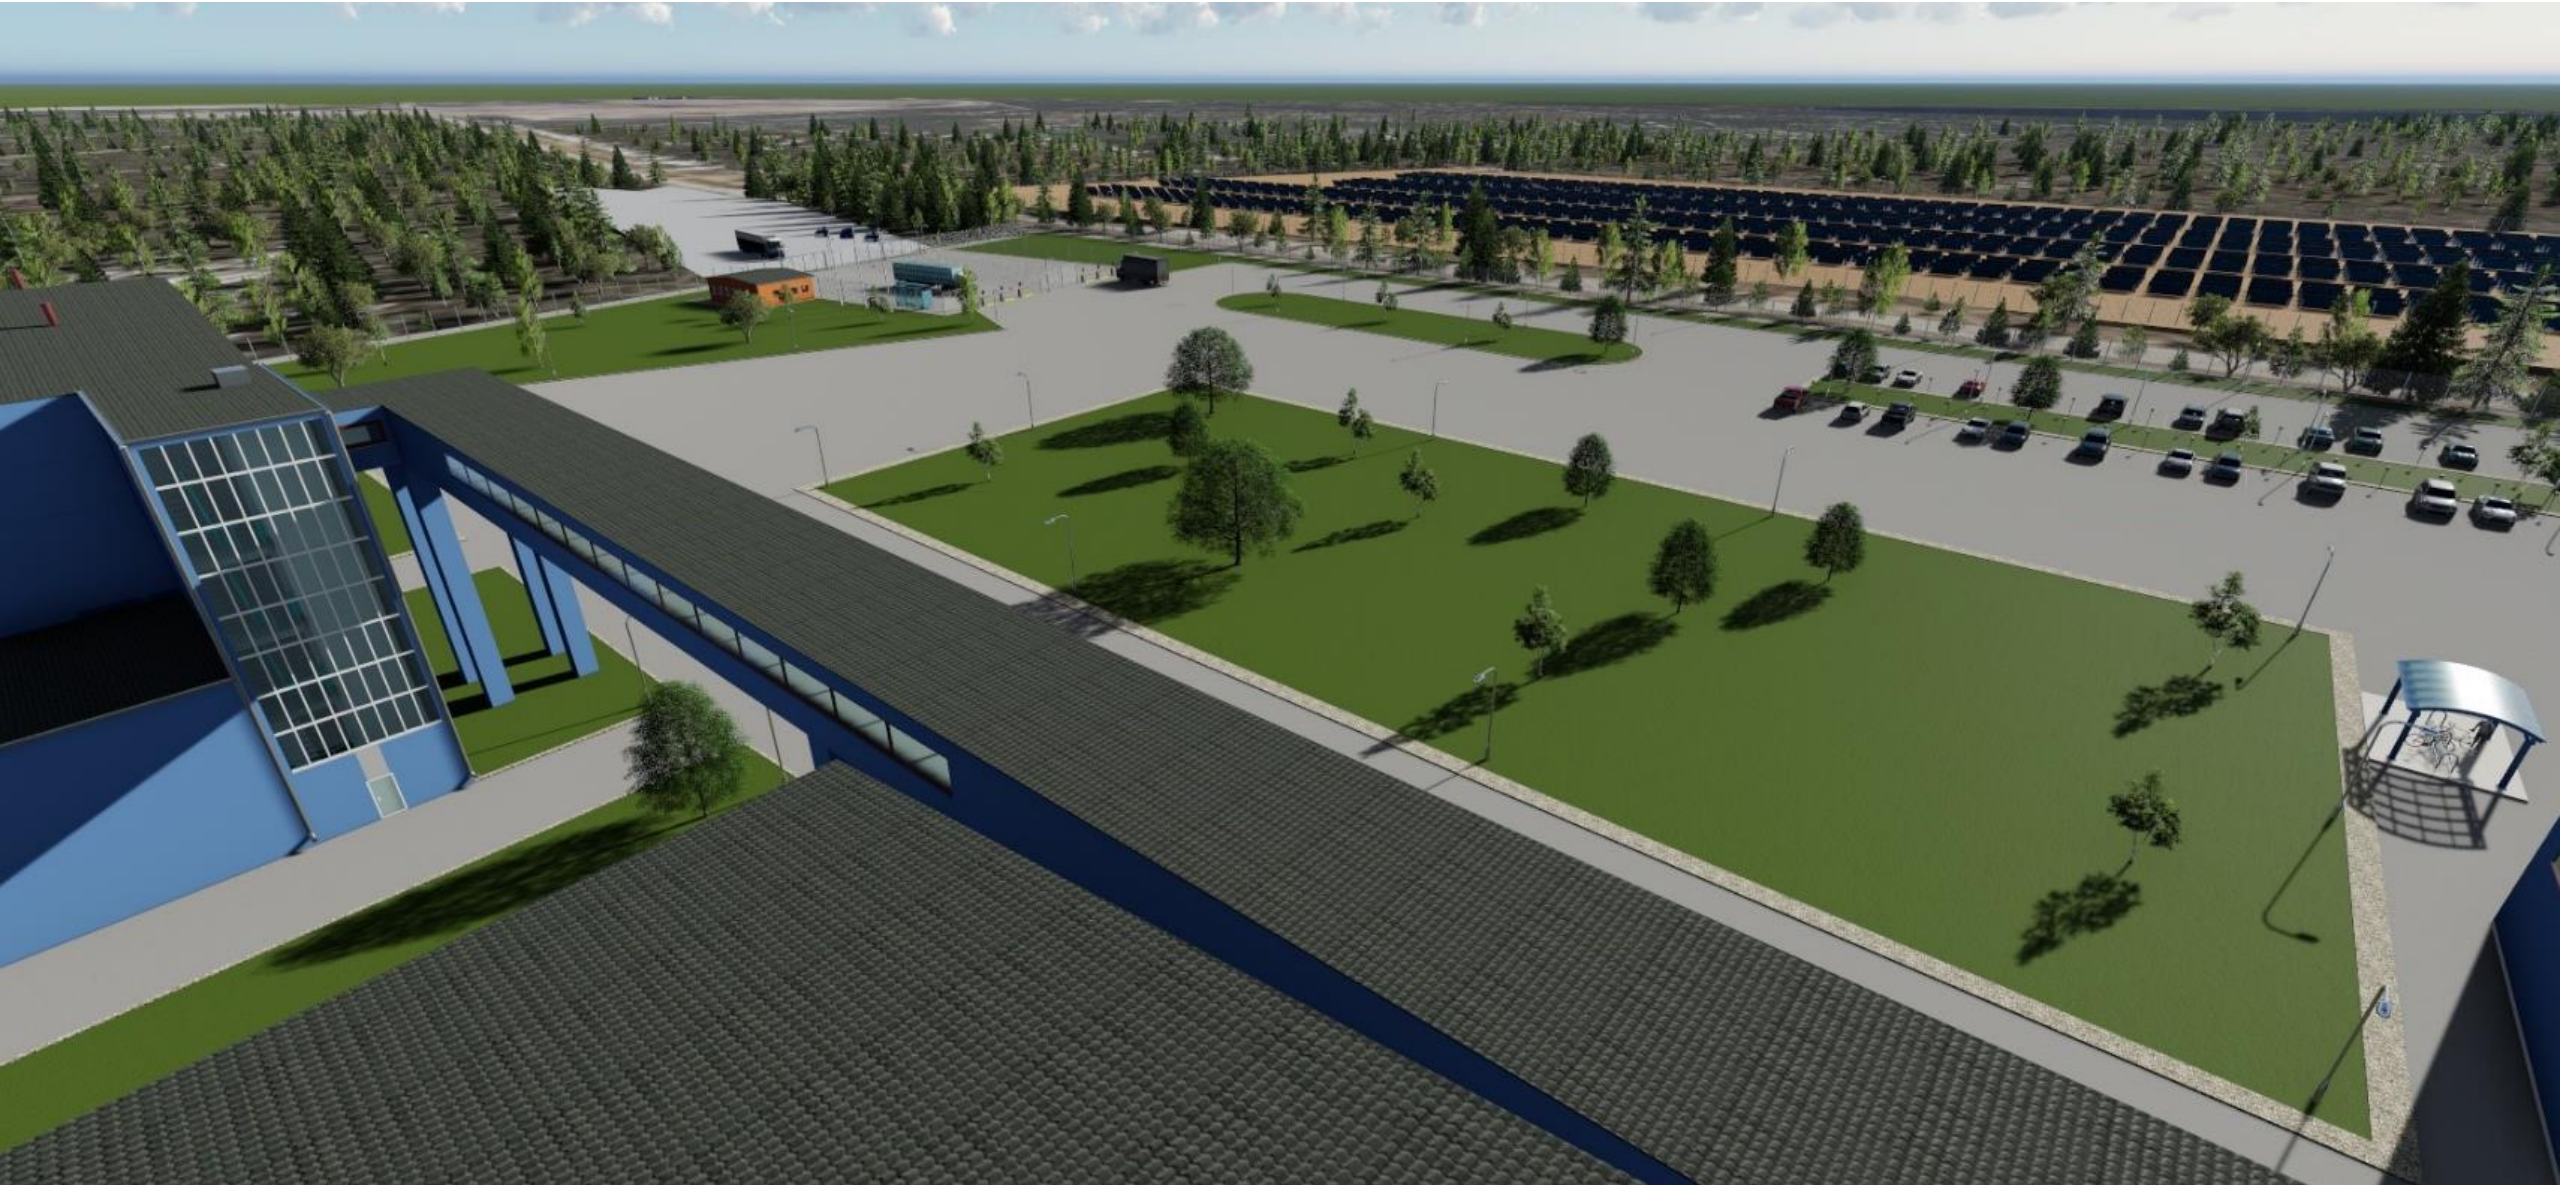

# Water cooling utilization example



# Water cooling utilization example

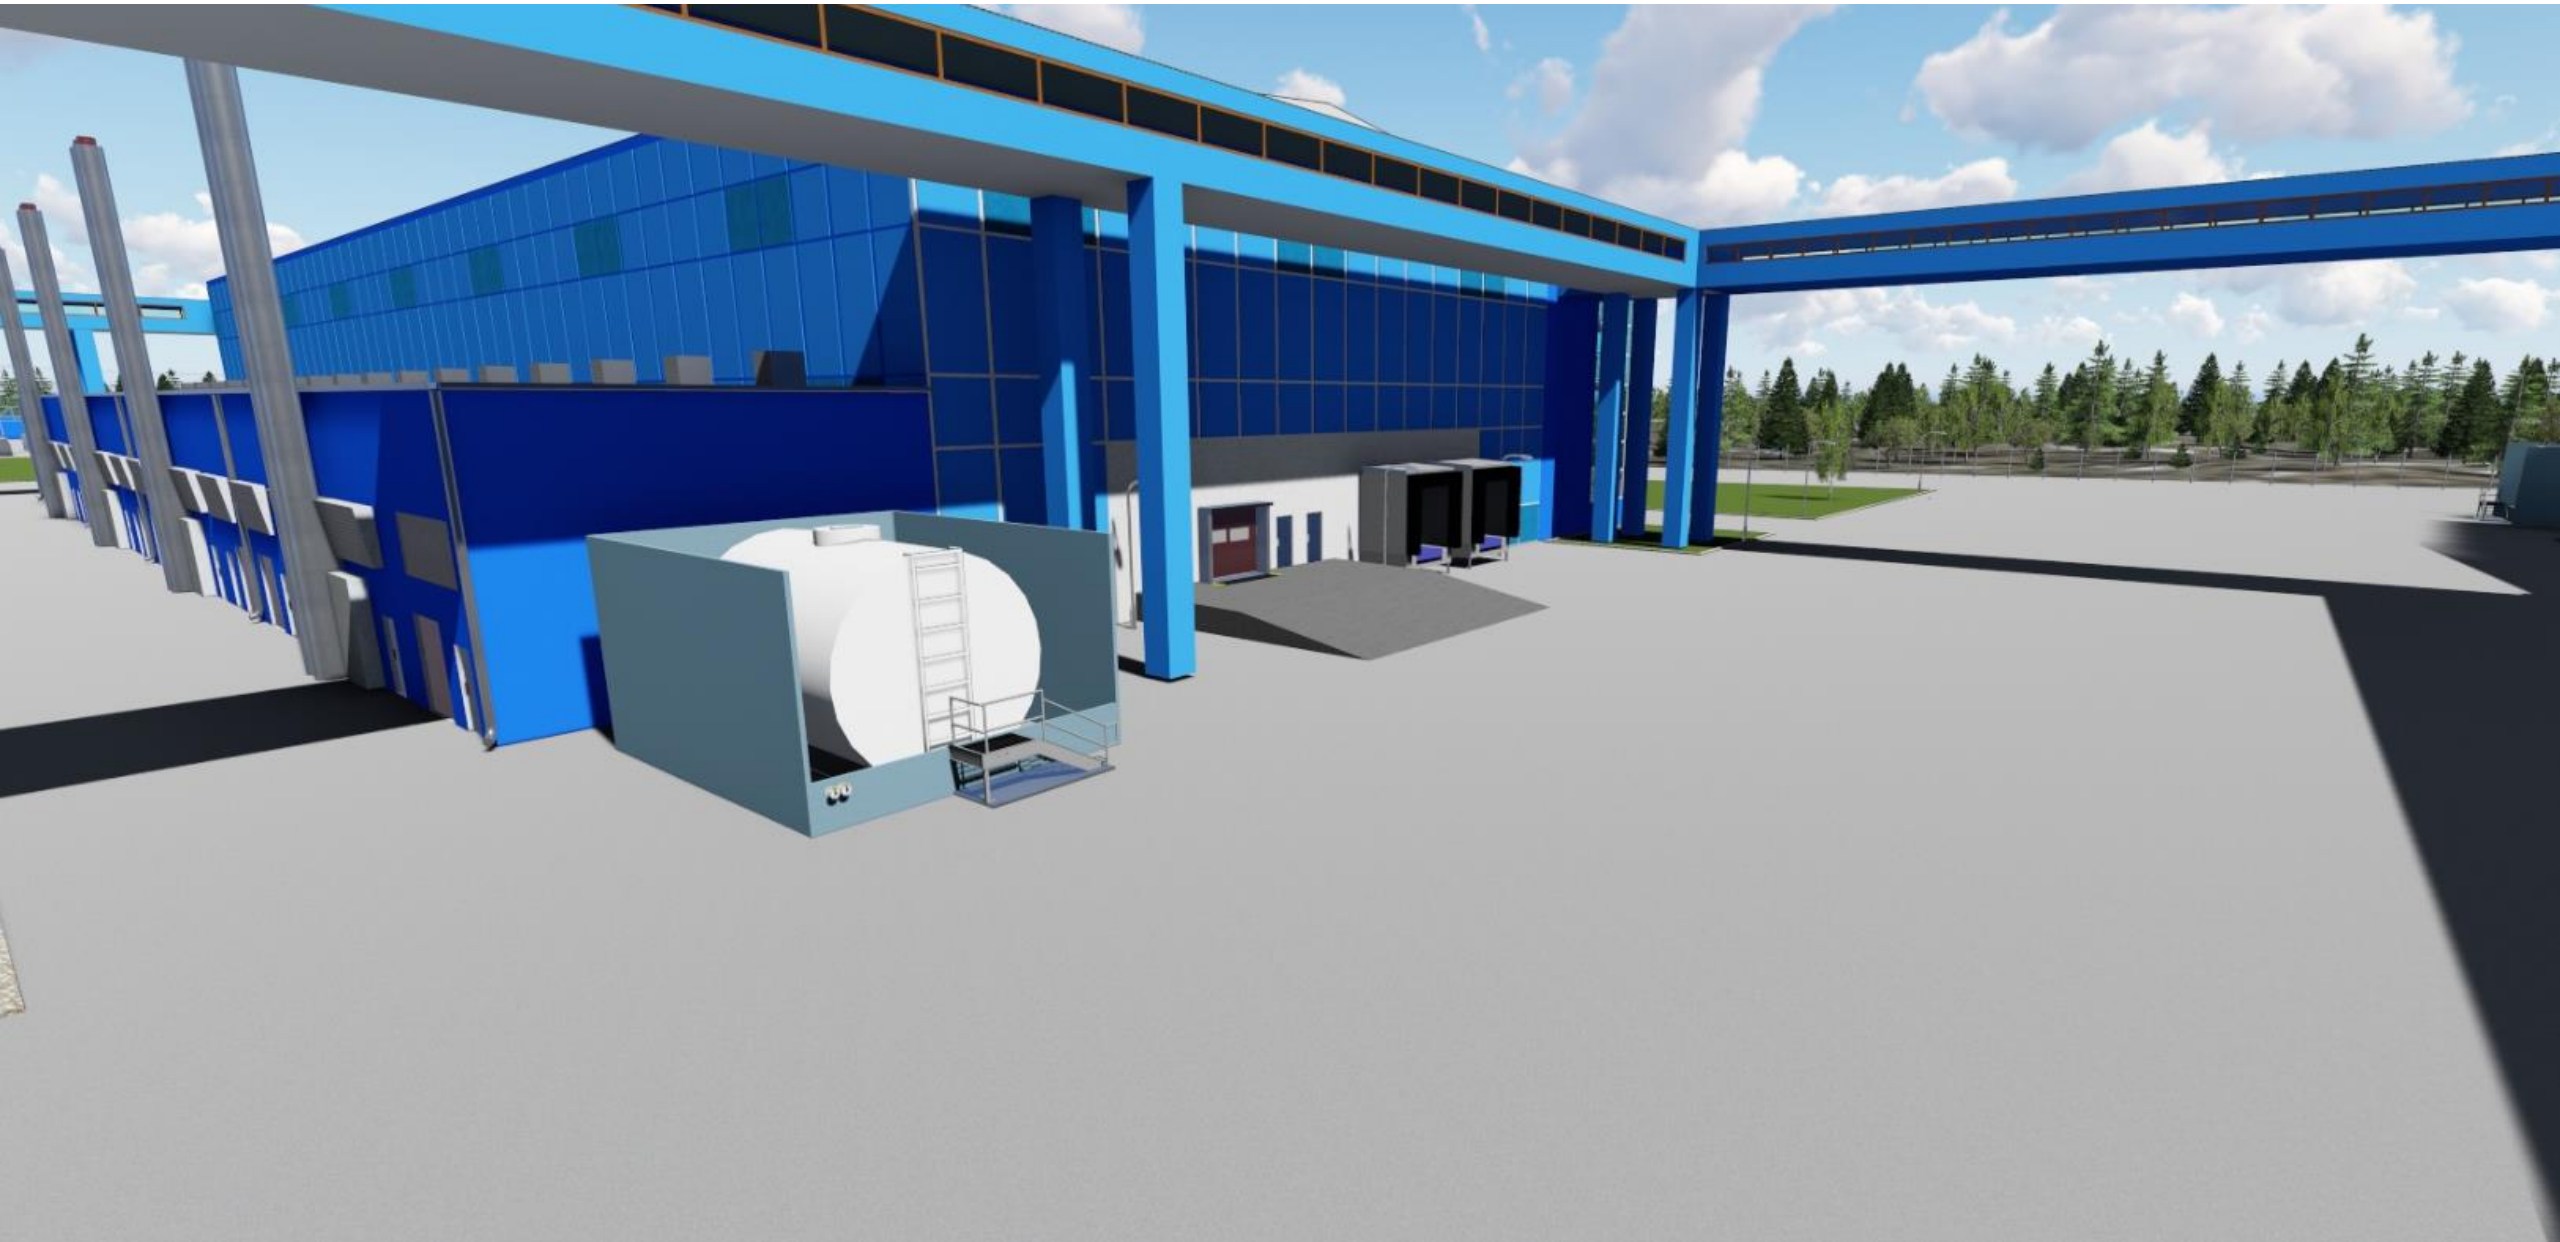



# Water cooling utilization example



# Water cooling utilization example




# Water cooling utilization example



# IMPLEMENTATION PLAN

# Implementation schedule

- Example schedule for data center investment in Finland

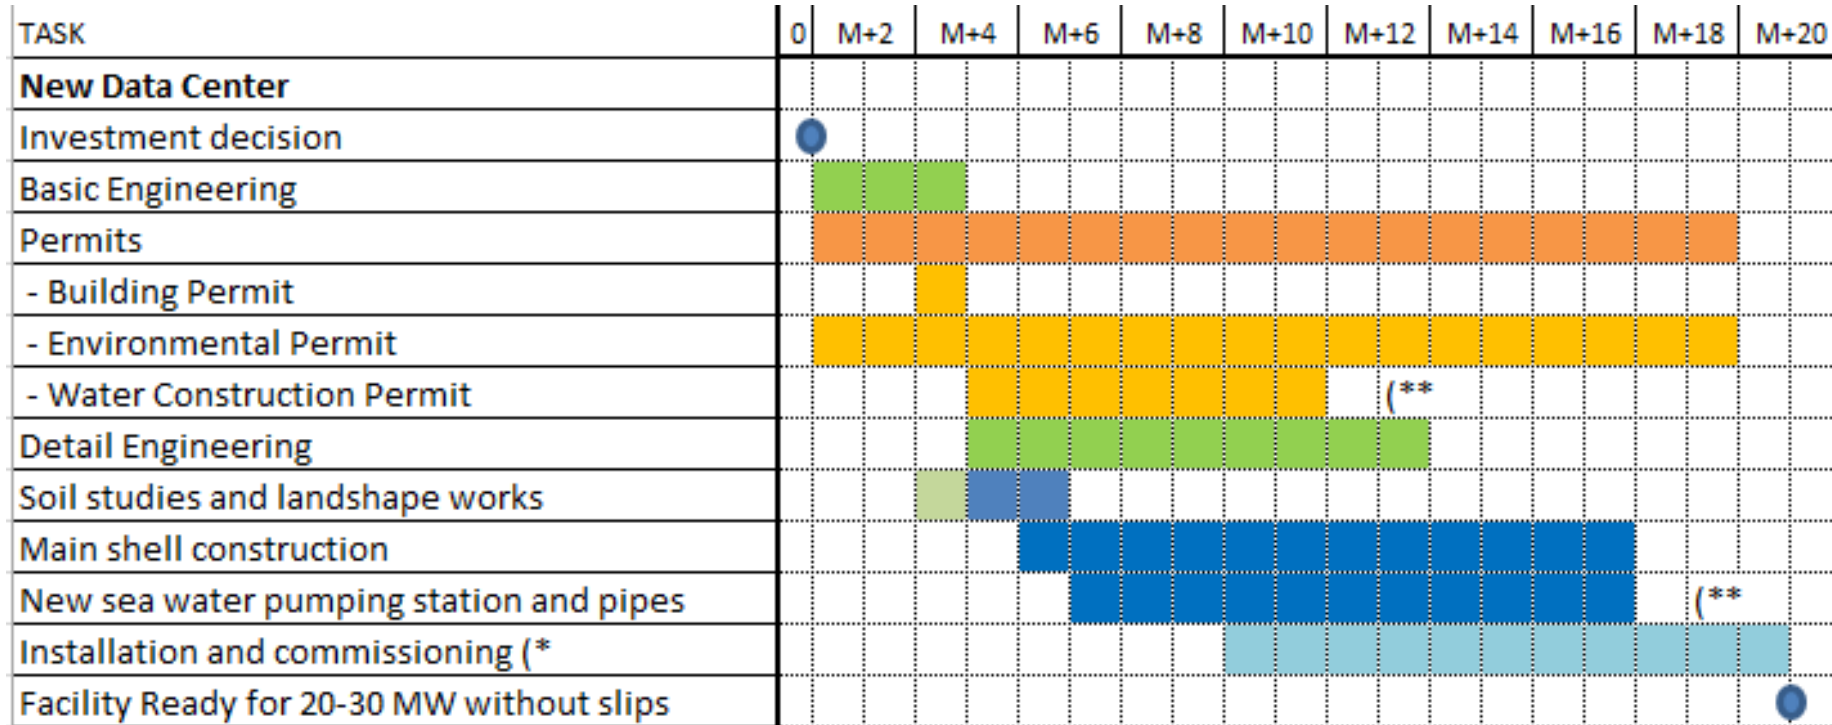

(\* Includes 1,5-2 month period for inquiries, tender comparisons, POs

(\*\* If it is decided to have sea water cooling system

# Remarks for the Implementation Schedule

- Feasibility Study is completed before the investment decision and Basic Engineering should continue in streamline
  - Layout, cooling process, electrification and automation system are usually fixed in Basic Engineering phase
- Permitting process should also start immediately after the Investment Decision
  - Especially Environmental Permit requires full attention in order to get accepted before operation starts
  - Other Permits should be accepted before construction starts
- Building shell and roof construction and water construction works are easier and cheaper done in summer time
- All equipment or materials that requires longer delivery time should be ordered first in order to avoid slips in start-up
- All construction, installation and commissioning contractors should have proven record of successful contracts preferably also to foreign customers and English speaking main personnel to taking care of the project